

# JUMO dTRANS p20

## Process pressure transmitter



**HART**  
COMMUNICATION PROTOCOL



### Operating Manual



40302500T90Z001K000

V11.00/EN/00525980/2025-09-08



# Table of contents

---

|          |                                                        |           |
|----------|--------------------------------------------------------|-----------|
| <b>1</b> | <b>Safety information</b>                              | <b>5</b>  |
| 1.1      | Hazardous materials                                    | 5         |
| <b>2</b> | <b>General information</b>                             | <b>6</b>  |
| 2.1      | Areas of application                                   | 6         |
| 2.2      | Scope of delivery                                      | 7         |
| 2.3      | Trademark information                                  | 9         |
| <b>3</b> | <b>Identifying the device version</b>                  | <b>10</b> |
| 3.1      | Nameplate                                              | 10        |
| 3.2      | Order details                                          | 10        |
| 3.3      | Accessories                                            | 13        |
| 3.4      | Software                                               | 13        |
| <b>4</b> | <b>Technical data</b>                                  | <b>14</b> |
| 4.1      | General Information                                    | 14        |
| 4.2      | Ex identification markings                             | 15        |
| 4.3      | Electrical data                                        | 15        |
| 4.4      | Inputs                                                 | 16        |
| 4.4.1    | Measuring range and accuracy                           | 16        |
| 4.5      | Outputs                                                | 18        |
| 4.6      | Environmental influences                               | 19        |
| 4.7      | Mechanical features                                    | 20        |
| 4.7.1    | Process connections                                    | 21        |
| 4.8      | Approval marks and certificates                        | 22        |
| 4.9      | Dimensions                                             | 23        |
| 4.9.1    | Process connections                                    | 25        |
| <b>5</b> | <b>Mounting</b>                                        | <b>27</b> |
| 5.1      | Before mounting                                        | 27        |
| 5.2      | Unscrew the front ring or case lid                     | 27        |
| 5.3      | Rotating the LCD (display)                             | 28        |
| 5.4      | Rotating the housing                                   | 29        |
| 5.5      | Pressure connection                                    | 30        |
| 5.6      | Measuring the relative or absolute pressure            | 31        |
| 5.7      | Bracket for wall and pipe mounting                     | 34        |
| 5.8      | Level measurement with or without a pressure separator | 35        |
| 5.8.1    | General information for a system with a diaphragm seal | 35        |
| 5.9      | Assembly in the explosion area                         | 36        |

---

# Table of contents

---

|           |                                                                                                     |           |
|-----------|-----------------------------------------------------------------------------------------------------|-----------|
| <b>6</b>  | <b>Installation</b>                                                                                 | <b>37</b> |
| 6.1       | Installation notes                                                                                  | 37        |
| 6.2       | Device with cable gland                                                                             | 37        |
| 6.3       | Device with M12 plug connector                                                                      | 40        |
| 6.4       | Electrical connection in Ex areas                                                                   | 42        |
| 6.4.1     | Connection diagram "Ex"                                                                             | 43        |
| <b>7</b>  | <b>Operation</b>                                                                                    | <b>44</b> |
| 7.1       | Display                                                                                             | 44        |
| 7.2       | Operation with rotary knob or with setup programm                                                   | 44        |
| 7.3       | The level concept                                                                                   | 46        |
| 7.3.1     | The display level                                                                                   | 47        |
| 7.3.2     | The parameter level                                                                                 | 48        |
| <b>8</b>  | <b>Configuration</b>                                                                                | <b>51</b> |
| 8.1       | Data flow diagram                                                                                   | 51        |
| 8.2       | Description of the possible configurations                                                          | 52        |
| 8.3       | Level measurement configuration with a pressure specification - recommended (tank empty, tank full) | 56        |
| 8.4       | Level measurement configuration without a pressure specification with or without a diaphragm seal   | 57        |
| <b>9</b>  | <b>Maintenance</b>                                                                                  | <b>59</b> |
| 9.1       | Overcoming errors and malfunctions                                                                  | 59        |
| <b>10</b> | <b>HART 7 specification</b>                                                                         | <b>60</b> |
| 10.1      | Device identification                                                                               | 60        |
| 10.2      | Variable codes                                                                                      | 60        |
| 10.3      | HART commands                                                                                       | 61        |
| 10.4      | Burst mode commands                                                                                 | 64        |
| 10.5      | Performance data                                                                                    | 65        |
| <b>11</b> | <b>Certificates</b>                                                                                 | <b>66</b> |

---

# 1 Safety information

---

## General

This manual contains information that must be observed in the interest of your own safety and to avoid material damage. This information is supported by symbols which are used in this manual as indicated.

Please read this manual before starting up the device. Store this manual in a place that is accessible to all users at all times.

If difficulties occur during startup, please do not intervene in any way that could jeopardize your warranty rights!

## Warning symbols



### DANGER!

This symbol indicates that **personal injury from electrocution** may occur if the appropriate precautionary measures are not taken.

---



### CAUTION!

This symbol in connection with the signal word indicates that **material damage or data loss** will occur if the respective precautionary measures are not taken.

---

## Note symbols



### NOTE!

This symbol refers to **important information** about the product, its handling, or additional benefits.

---

## 1.1 Hazardous materials

Using hazardous materials as a medium may result in abrasive and corrosive damage to components of the product that come into contact with the medium. The medium may leak and present a fire hazard and a risk to health.

Carry out a risk assessment taking into consideration the safety data sheet for the relevant hazardous substance for mounting, operation, maintenance, cleaning, and disposal:

- Comparison and systematic checking of the durability of the components of the product that come into contact with the medium and the admissible environmental influences.
- Assessment of the risk to people and the environment.
- Assessment of the fire hazard due to the product materials, the admissible environmental influences, and the voltage supply.

## 2 General information

---



### DANGER!

The device is suitable for measuring pressure in gases and liquids without solids content. In the SIL version (functional safety), this device is used in safety-related systems for minimum, maximum and area monitoring that fulfil the requirements of the series of standards IEC 61508:2010.

A failure of the device or other devices connected to it, e.g. due to an operating error, can lead to dangerous malfunctions of the whole plant.

► Therefore please also observe the corresponding safety manual from the device series.

---



### NOTE!

Read this operating manual before putting the device into service. Keep the operating manual in a place that is accessible to all users at all times.

All necessary settings are described in this operating manual. Nevertheless, should problems be encountered during startup please do not make any unauthorized manipulations. This could endanger your rights under the warranty!

Please contact the nearest branch office or the head office.

---

### 2.1 Areas of application

The device with the HART interface combines maximum precision with simple operation. It is used to measure the system pressure of gas, steam and liquids. The built-in LCD displays measured values and device data. The device can be installed up to zone 0 in the version with explosion protection "Ex ia (intrinsically safe)".

The housing and sensor are manufactured from high-grade stainless steel. Diaphragm seals can also be connected for specific process technology applications (see data sheets 409772 to 409784).

The pressure transmitter can be programmed and can therefore be flexibly adapted for various measuring tasks. There is an easy-to-use setup program available as an accessory for operation via interfaces. A rotary knob allows for quick and easy on-site manual operation.

The pressure transmitter with 4 to 20 mA and HART protocol was evaluated with regard to functional safety and is certified by exida according to IEC 61508 -1/-2/-3:2010. These measuring devices are suitable for monitoring process level and process pressure up to SIL2. Further details can be found in the Safety Manual.

#### Use in "Ex-area"

In the **Ex ia** version, the device is permitted for use in the "Ex-area" if it has a corresponding identification marking on the nameplate.

#### Functional safety use

In the SIL version, the device is permitted for use according to IEC 61508 if it has a corresponding identification marking on the nameplate.

#### Application areas

The device can be used for various applications, e.g.

- For level measurements
- For foam formation
- In containers with mixers or sieve installations
- For liquid gases

### Measured process variables

Pressure

### Calculated process variables


Filling level (level, volume or mass)



#### CAUTION!

**The device's membranes must not be damaged at the process connection!**

- ▶ Do not insert any objects into the drilled holes of the pressure connections!  
The device must be sent back if there is damage to the housing or membrane!

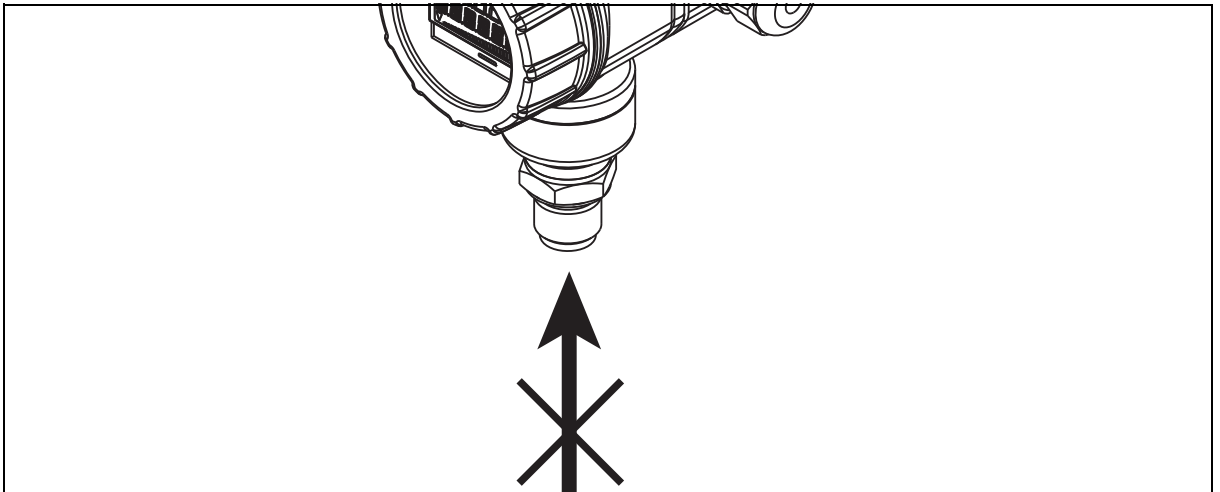

## 2.2 Scope of delivery

### Operating Manual

The operating manual describes the mounting, the electrical connection, the startup and operation of the device.

### Safety manual (option)

The safety manual describes the safe application with the installation according to IEC 61508.

### Calibration certificate

The device is supplied with a calibration certificate and a setup print-out.

These documents contain information about the set parameters and/or the measured parameters for the respective device.

If the calibration certificate is lost or if you need another copy, the calibration certificate can be requested from the manufacturer by specifying the device's F number (see nameplate). You will find the supplier's address on the back cover of the manual.

## 2 General information

---

### Setup program (option)

The setup program is available as an option: part no. 00537577

All the device's parameters can be conveniently checked and adjusted using the setup program - there are also additional functions, e.g.:

- Recording the measured values
- Graphical view of temperature and pressure
- Detailed diagnostic messages
- Display of the complete order code and the device configuration (for follow-up orders)

The setup program accesses the device via

- the JUMO interface (standard) or
- the HART interface (optional)



#### **DANGER!**

**The JUMO interface must not be used in the Ex-area!**

**The device may only be operated using the rotary knob or the HART interface!**

---

### PC interface cable (option)

Available as an accessory: PC interface cable with USB/TTL converter and two adapters (USB transmitter cable), part no. 00456352.

The device can be connected to a PC's USB port via the JUMO interface with the PC interface cable.

### HART<sup>®</sup> modem (option)

Available as an accessory: HART<sup>®</sup> modem for USB, part no. 00443447.

The device can be connected to a PC's USB port via the HART<sup>®</sup> interface with the HART<sup>®</sup> modem.

### Input isolating amplifier (option)

Available as an accessory: Input isolating amplifier for Ex-applications, HART-capable, part no. 00577948.

Devices with explosion protection ATEX Ex ia must be connected via an input isolating amplifier for use in the Ex-area!

### Diaphragm seal (option)

Available as an accessory: see data sheets 409770 to 409786.

Diaphragm seals are used for adjusting to particular applications if conventional pressure connections cannot be used.



#### **CAUTION!**

**Diaphragm seals are installed by default and must not be removed from the device!**

---

### Valve manifolds (option)

Available as an accessory: see data sheet 409706.

### JUMO PEKA – Hygienic process connection (option)

Available as an accessory: see data sheet 409711.

### **Additional JUMO accessories (option)**

Additional accessories available: see data sheet 409700 (shut-off valves, measurement device holders, transition pieces, seals, etc.).


### **2.3 Trademark information**

All trademarks and trade and company names used are the property of their rightful owners or authors.

## 3 Identifying the device version

### 3.1 Nameplate

Sample identification marking on the device housing:

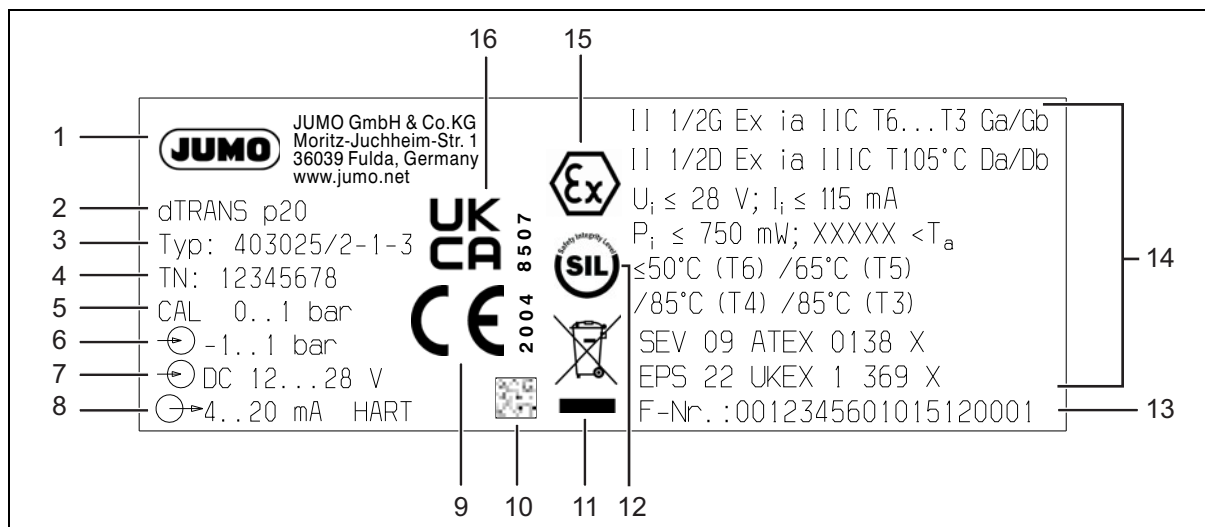

|   |                             |    |                    |
|---|-----------------------------|----|--------------------|
| 1 | Manufacturer                | 9  | CE marking         |
| 2 | Device designation          | 10 | DMC-Code           |
| 3 | Type                        | 11 | Disposal           |
| 4 | Part no.                    | 12 | SIL marking        |
| 5 | Measuring range factory set | 13 | Fabrication number |
| 6 | Nominal measuring range     | 14 | Ex details         |
| 7 | Voltage supply              | 15 | Ex marking         |
| 8 | Output signal               | 16 | UKCA marking       |

#### Date of manufacture

The device's date of manufacture (year and calendar week) is part of the fabrication number. Numbers 12 to 15 denote the year of manufacture and the calendar week.

### 3.2 Order details

| (1) Basic type            |                                                          |
|---------------------------|----------------------------------------------------------|
| 403025                    | JUMO dTRANS p20 - process pressure transmitter           |
| (2) Basic type extension  |                                                          |
| 0                         | None                                                     |
| 2                         | SIL <sup>a, b</sup>                                      |
| (3) Explosion protection  |                                                          |
| 0                         | None                                                     |
| 1                         | ATEX Ex ia <sup>c</sup>                                  |
| (4) Housing               |                                                          |
| 1                         | Short, stainless steel, with M12 connection <sup>d</sup> |
| 2                         | Long, stainless steel, with cable fitting                |
| 3                         | Precision casting, with cable fitting M20                |
| (5) Electrical connection |                                                          |
| 36                        | M12 plug connector <sup>c</sup>                          |
| 82                        | Plastic cable fitting                                    |

### 3 Identifying the device version

|                                            |                                                                               |
|--------------------------------------------|-------------------------------------------------------------------------------|
| 93                                         | Metal cable fitting                                                           |
| <b>(6) Cover material</b>                  |                                                                               |
| 20                                         | CrNi (stainless steel)                                                        |
| 85                                         | Plastic                                                                       |
| <b>(7) Display</b>                         |                                                                               |
| 0                                          | None                                                                          |
| 1                                          | Display (LCD)                                                                 |
| <b>(8) Operation</b>                       |                                                                               |
| 0                                          | None                                                                          |
| 1                                          | Control knob                                                                  |
| <b>(9) Input – nominal measuring range</b> |                                                                               |
| 450                                        | -600 to +600 mbar relative pressure                                           |
| 473                                        | -1 to +2.5 bar relative pressure                                              |
| 513                                        | -1 to +4 bar relative pressure                                                |
| 472                                        | -1 to +10 bar relative pressure                                               |
| 514                                        | -1 to +25 bar relative pressure <sup>e</sup>                                  |
| 515                                        | -1 to +100 bar relative pressure <sup>f</sup>                                 |
| 508                                        | -1 to +250 bar relative pressure <sup>f</sup>                                 |
| 516                                        | -1 to +600 bar relative pressure <sup>f</sup>                                 |
| 487                                        | 0 to 0.6 bar absolute pressure                                                |
| 490                                        | 0 to 2.5 bar absolute pressure                                                |
| 491                                        | 0 to 4 bar absolute pressure                                                  |
| 493                                        | 0 to 10 bar absolute pressure                                                 |
| 495                                        | 0 to 25 bar absolute pressure <sup>e</sup>                                    |
| 507                                        | 0 to 100 bar absolute pressure <sup>e</sup>                                   |
| <b>(10) Output</b>                         |                                                                               |
| 405                                        | 4 to 20 mA, two-wire                                                          |
| 410                                        | 4 to 20 mA, two-wire with HART protocol                                       |
| <b>(11) Process connection</b>             |                                                                               |
| 504                                        | G 1/2 according to DIN EN 837                                                 |
| 512                                        | 1/2" – 14 NPT according to DIN EN 837                                         |
| 559                                        | M20 × 1.5 according to DIN 3852-11                                            |
| 564                                        | 1/2" – 14 NPT internal                                                        |
| 571                                        | G 3/4 front-flush according to DIN EN ISO 228-1                               |
| 583                                        | M20 × 1.5 with pin                                                            |
| 604                                        | Taper socket with union nut DN 25 according to DIN 11851 (dairy pipe fitting) |
| 606                                        | Taper socket with union nut DN 40 according to DIN 11851 (dairy pipe fitting) |
| 613                                        | Clamping socket (clamp) DN 25 according to DIN 32676                          |
| 616                                        | Clamping socket (clamp) DN 50 according to DIN 32676 (2" ISO 2852)            |
| 652                                        | Tank connection with grooved union nut DN 25                                  |
| 997                                        | JUMO PEKA – Hygienic process connection                                       |
| 998                                        | Diaphragm seal version, screwed                                               |
| <b>(12) Medium temperature</b>             |                                                                               |
| 1                                          | Up to 120 °C                                                                  |
| 2                                          | Up to 200 °C                                                                  |
| <b>(13) Process connection material</b>    |                                                                               |

- a Only available with output 410 and display 1. Not available with input 507, 508, 516, process connection 998 or extra code 681.
- b Only available with material process connection 20.
- c Only available with output 410. Not available with electrical connection 82, cover material 85 or process connection 997. The medium temperature 1 is valid until 115 °C. The medium temperature 2 is valid until 175 °C.
- d The housing 1 is only available with electrical connection 36 and vice versa.
- e Not available with process connection 616.
- f Not available with process connection 571, 604, 606, 613, 616, 997.
- g Not available with input 450, 472, 473, 487, 490, 491, 493, 513.
- h Only available with input 508, 516.
- i Specify in plain text. Default setting see "Measuring range and accuracy".
- j Only available with process connection 512, 564 and process connection material 82. Not available with input 450, 487.
- k Only available with explosion protection 1. Not available with input 516.
- l Only available with process connection 504 or 512, process connection material 20 and medium temperature 1.

12

## 3 Identifying the device version

### 3.3 Accessories

| Designation                                                                                 | Part no.   |
|---------------------------------------------------------------------------------------------|------------|
| Line socket, 4-pole, M12 × 1, straight, length 2 m                                          | 00404585   |
| Line socket, 4-pole, M12 × 1, angled, length 2 m                                            | 00409334   |
| PC interface with USB/TTL converter                                                         | 00456352   |
| HART modem, USB                                                                             | 00443447   |
| Ex-i repeater power supply and input isolating amplifier                                    | 00577948   |
| Measuring device holder for wall and 2" pipe                                                | 00597711   |
| Calibration of the mechanical measurement value pressure on site (also DAkkS)               | 00758363   |
| Designation                                                                                 | Data sheet |
| Valve blocks                                                                                | 409706     |
| JUMO PEKA – Hygienic process connection                                                     | 409711     |
| Diaphragm seal with dairy pipe fitting                                                      | 409772     |
| Diaphragm seal with clamp connection                                                        | 409774     |
| Diaphragm seal with DRD flange or Varivent socket                                           | 409776     |
| Diaphragm seal with ISS/SMS/RJT socket and (grooved) union nut                              | 409778     |
| Diaphragm seal with membrane                                                                | 409780     |
| Diaphragm seal with screw-in thread DIN ISO 228/1 or ANSI B 1.201                           | 409782     |
| Diaphragm seal with flange connection according to DIN EN 1092-1 with sealing strip form B1 | 409784     |
| Diaphragm seal with flange connection according to ANSI B 16.5 with sealing strip type RF   | 409786     |
| Ex-i repeater power supply and input isolating amplifier                                    | 707530     |

The PC interface cable is the connection between the JUMO interface of the differential pressure transmitter and the USB interface of a PC.

The HART modem is the connection between the HART interface of the differential pressure transmitter and the USB interface of a PC.

### 3.4 Software

| Description                                | Part no. |
|--------------------------------------------|----------|
| JUMO setup dTRANS p20 series               | 00537577 |
| Device Type Manager (DTM), JUMO dTRANS p20 | 00738288 |

## 4 Technical data

### 4.1 General Information

|                                            |                                                                                                                                                |
|--------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------|
| Reference conditions                       | DIN EN 60770, DIN EN 61298                                                                                                                     |
| Ambient temperature                        | 22 °C ±5 K                                                                                                                                     |
| Air pressure                               | 1000 hPa (±25 hPa)                                                                                                                             |
| Voltage supply                             | DC 24 V                                                                                                                                        |
| Burden                                     | 50 Ω                                                                                                                                           |
| Sensor system                              | Silicon sensor with stainless steel separating diaphragm/thin film sensor                                                                      |
| Pressure transfer medium                   |                                                                                                                                                |
| For measuring system filling medium 0      | Without transfer medium                                                                                                                        |
| For measuring system filling medium 1      | Silicon oil, FDA compliant                                                                                                                     |
| Admissible load changes                    | > 10 million                                                                                                                                   |
| Position                                   |                                                                                                                                                |
| Mounting position                          | Any                                                                                                                                            |
| Calibration position                       | Device upright, process connection at the bottom                                                                                               |
| Zero offset depending on position          | Relative pressure: a zero offset is possible on-site or via setup.<br>Absolute pressure: manual readjustment is possible.                      |
| For medium temperature 1<br>(up to 120 °C) | ≤ 1 mbar                                                                                                                                       |
| For medium temperature 2<br>(up to 200 °C) | ≤ 10 mbar                                                                                                                                      |
| Display <sup>a</sup>                       | LCD, two-line with bar graph                                                                                                                   |
| Alignment                                  | Display unit rotatable in 90° steps<br>Housing rotatable ±160°                                                                                 |
| Size                                       | Display 22 × 35 mm, font size 7 mm, 5 digits                                                                                                   |
| Color                                      | Black                                                                                                                                          |
| Portrayable measuring units                |                                                                                                                                                |
| Input pressure                             | mH <sub>2</sub> O, inH <sub>2</sub> O, inHg, ftH <sub>2</sub> O, mmH <sub>2</sub> O, mmHg, psi, bar, mbar, kg/cm <sup>2</sup> , kPa, Torr, MPa |
| Measured value                             | % or scaled with freely adjustable measuring unit                                                                                              |
| Output current                             | mA                                                                                                                                             |
| Sensor temperature                         | °C, °F                                                                                                                                         |
| Additional display data                    | Minimum pressure, maximum pressure, error, overrange, underrange, operating hours, device parameters                                           |
| Operation                                  |                                                                                                                                                |
| On-site                                    | With rotary knob and LCD                                                                                                                       |
| Setup program                              | Via interface                                                                                                                                  |
| Interface                                  |                                                                                                                                                |
| Standard                                   | JUMO interface <sup>b</sup>                                                                                                                    |
| For output 410 (4 to 20 mA with HART)      | JUMO interface <sup>b</sup> and HART interface                                                                                                 |

<sup>a</sup> Optional; SIL version only available with display.

<sup>b</sup> The JUMO interface may not be used in a potentially explosive area! In such a case the device can be operated via the rotary knob or the HART interface.

### 4.2 Ex identification markings

|            |                                                                       |
|------------|-----------------------------------------------------------------------|
| ATEX, UKEX | II 1/2G Ex ia IIC T6 ... T3 Ga/Gb<br>II 1/2D Ex ia IIIC T105 °C Da/Db |
|------------|-----------------------------------------------------------------------|

### 4.3 Electrical data

|                                                                                        |                                                                                                                                                                                                                                                                                              |
|----------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| For version<br>Explosion protection 0 (without)<br>Explosion protection 1 (ATEX Ex ia) | DC 12 to 36 V<br>DC 12 to 28 V<br>The voltage supply must be intrinsically safe and must not exceed the following maximum values:<br>$U_i \leq \text{DC } 28 \text{ V}$<br>$I_i \leq 115 \text{ mA}$<br>$P_i \leq 750 \text{ mW}$<br>$C_i = 6 \text{ nF}$<br>$L_i = 105 \text{ }\mu\text{H}$ |
|----------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

## 4 Technical data

### 4.4 Inputs

#### 4.4.1 Measuring range and accuracy

##### Relative pressure

|                                                                        | Nominal measuring range                        |                                              |                                              |                                              |
|------------------------------------------------------------------------|------------------------------------------------|----------------------------------------------|----------------------------------------------|----------------------------------------------|
|                                                                        | -600 to +600 mbar                              | -1 to +2.5 bar                               | -1 to +4 bar                                 | -1 to +10 bar                                |
| Default measuring range                                                | 0 to 600 mbar                                  | 0 to 2.5 bar                                 | 0 to 4 bar                                   | 0 to 10 bar                                  |
| Smallest MSP <sup>a</sup>                                              | 60 mbar                                        | 0.1 bar                                      | 0.1 bar                                      | 0.5 bar                                      |
| Turndown ratio (r) <sup>b</sup>                                        | $r \leq 20$                                    | $r \leq 35$                                  | $r \leq 50$                                  | $r \leq 22$                                  |
| Non-linearity for reference conditions <sup>c</sup>                    | 0.06 %                                         | 0.04 %                                       | 0.04 %                                       | 0.04 %                                       |
| Accuracy in % of the set MSP<br>Range: -20 to +60 °C                   | $r \times 0.12 \%$<br>for $1 \leq r \leq 20$   | $r \times 0.08 \%$<br>for $1 \leq r \leq 35$ | $r \times 0.08 \%$<br>for $1 \leq r \leq 50$ | $r \times 0.08 \%$<br>for $1 \leq r \leq 22$ |
| Accuracy in % of the set MSP<br>Range: -40 to -20 °C<br>or 60 to 85 °C | $r \times 0.18 \%$<br>for $1 \leq r \leq 20^d$ | $r \times 0.12 \%$<br>for $1 \leq r \leq 35$ | $r \times 0.12 \%$<br>for $1 \leq r \leq 50$ | $r \times 0.12 \%$<br>for $1 \leq r \leq 22$ |
| Long-term stability in % as of the nominal measuring range             | 0.1 %/year                                     |                                              |                                              |                                              |
| Overload capability                                                    | 6 bar                                          | 15 bar                                       | 30 bar                                       | 60 bar                                       |
| Burst pressure                                                         | 12 bar                                         | 30 bar                                       | 60 bar                                       | 100 bar                                      |

|                                                                        | Nominal measuring range                      |                                              |                                              |                                              |
|------------------------------------------------------------------------|----------------------------------------------|----------------------------------------------|----------------------------------------------|----------------------------------------------|
|                                                                        | -1 to +25 bar                                | -1 to +100 bar                               | -1 to +250 bar                               | -1 to +600 bar                               |
| Default measuring range                                                | 0 to 25 bar                                  | 0 to 100 bar                                 | 0 to 250 bar                                 | 0 to 600 bar                                 |
| Smallest MSP <sup>a</sup>                                              | 0.5 bar                                      | 5 bar                                        | 12.5 bar                                     | 30 bar                                       |
| Turndown ratio (r) <sup>b</sup>                                        | $r \leq 52$                                  | $r \leq 20$                                  | $r \leq 20$                                  | $r \leq 20$                                  |
| Non-linearity for reference conditions <sup>c</sup>                    | 0.04 %                                       | 0.04 %                                       | 0.04 %                                       | 0.08 %                                       |
| Accuracy in % of the set MSP<br>Range: -20 to +60 °C                   | $r \times 0.08 \%$<br>for $1 \leq r \leq 52$ | $r \times 0.08 \%$<br>for $1 \leq r \leq 20$ | $r \times 0.08 \%$<br>for $1 \leq r \leq 20$ | $r \times 0.16 \%$<br>for $1 \leq r \leq 20$ |
| Accuracy in % of the set MSP<br>Range: -40 to -20 °C<br>or 60 to 85 °C | $r \times 0.12 \%$<br>for $1 \leq r \leq 52$ | $r \times 0.12 \%$<br>for $1 \leq r \leq 20$ | $r \times 0.12 \%$<br>for $1 \leq r \leq 20$ | $r \times 0.24 \%$<br>for $1 \leq r \leq 20$ |
| Long-term stability in % as of the nominal measuring range             | 0.1 %/year                                   |                                              |                                              |                                              |
| Overload capability                                                    | 150 bar                                      | 300 bar                                      | 600 bar                                      | 1200 bar                                     |
| Burst pressure                                                         | 250 bar                                      | 400 bar                                      | 700 bar                                      | 2000 bar                                     |

<sup>a</sup> MSP = measuring span

<sup>b</sup>  $r$  = span of the nominal measuring range ÷ adjusted measuring span

<sup>c</sup> Reference conditions: ambient temperature 20 °C (±3 K), air pressure 1000 hPa (±25 hPa)

<sup>d</sup> Only up to -30 °C.

## 4 Technical data

### Absolute pressure

|                                                                        | Nominal measuring range                        |                                              |                                              |                                              |
|------------------------------------------------------------------------|------------------------------------------------|----------------------------------------------|----------------------------------------------|----------------------------------------------|
|                                                                        | 0 to 600 mbar                                  | 0 to 2.5 bar                                 | 0 to 4 bar                                   | 0 to 10 bar                                  |
| Default measuring range                                                | 0 to 600 mbar                                  | 0 to 2.5 bar                                 | 0 to 4 bar                                   | 0 to 10 bar                                  |
| Smallest MSP <sup>a</sup>                                              | 60 mbar                                        | 0.1 bar                                      | 0.1 bar                                      | 0.5 bar                                      |
| Turndown ratio (r) <sup>b</sup>                                        | $r \leq 10$                                    | $r \leq 20$                                  | $r \leq 40$                                  | $r \leq 20$                                  |
| Non-linearity for reference conditions <sup>c</sup>                    | 0.12 %                                         | 0.04 %                                       | 0.04 %                                       | 0.04 %                                       |
| Accuracy in % of the set MSP<br>Range: -20 to +60 °C                   | $r \times 0.24 \%$<br>for $1 \leq r \leq 10$   | $r \times 0.08 \%$<br>for $1 \leq r \leq 20$ | $r \times 0.08 \%$<br>for $1 \leq r \leq 40$ | $r \times 0.08 \%$<br>for $1 \leq r \leq 20$ |
| Accuracy in % of the set MSP<br>Range: -40 to -20 °C<br>or 60 to 85 °C | $r \times 0.36 \%$<br>for $1 \leq r \leq 10^d$ | $r \times 0.16 \%$<br>for $1 \leq r \leq 20$ | $r \times 0.16 \%$<br>for $1 \leq r \leq 40$ | $r \times 0.16 \%$<br>for $1 \leq r \leq 20$ |
| Long-term stability in % as of the nominal measuring range             | 0.1 %/year                                     |                                              |                                              |                                              |
| Overload capability                                                    | 6 bar                                          | 15 bar                                       | 30 bar                                       | 60 bar                                       |
| Burst pressure                                                         | 12 bar                                         | 30 bar                                       | 60 bar                                       | 100 bar                                      |

|                                                                        | Nominal measuring range                      |                                              |
|------------------------------------------------------------------------|----------------------------------------------|----------------------------------------------|
|                                                                        | 0 to 25 bar                                  | 0 to 100 bar                                 |
| Default measuring range                                                | 0 to 25 bar                                  | 0 to 100 bar                                 |
| Smallest MSP <sup>a</sup>                                              | 0.5 bar                                      | 5 bar                                        |
| Turndown ratio (r) <sup>b</sup>                                        | $r \leq 50$                                  | $r \leq 20$                                  |
| Non-linearity for reference conditions <sup>c</sup>                    | 0.04 %                                       | 0.04 %                                       |
| Accuracy in % of the set MSP<br>Range: -20 to +60 °C                   | $r \times 0.08 \%$<br>for $1 \leq r \leq 50$ | $r \times 0.08 \%$<br>for $1 \leq r \leq 20$ |
| Accuracy in % of the set MSP<br>Range: -40 to -20 °C<br>or 60 to 85 °C | $r \times 0.16 \%$<br>for $1 \leq r \leq 50$ | $r \times 0.12 \%$<br>for $1 \leq r \leq 20$ |
| Long-term stability in % as of the nominal measuring range             | 0.1 %/year                                   |                                              |
| Overload capability                                                    | 150 bar                                      | 300 bar                                      |
| Burst pressure                                                         | 250 bar                                      | 400 bar                                      |

<sup>a</sup> MSP = measuring span

<sup>b</sup>  $r$  = span of the nominal measuring range ÷ adjusted measuring span

<sup>c</sup> Reference conditions: ambient temperature 20 °C (±3 K), air pressure 1000 hPa (±25 hPa)

<sup>d</sup> Only up to -30 °C.

## 4 Technical data

---

### 4.5 Outputs

|                                                                                                                                        |                                                                                                                                                                                       |
|----------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Analog output<br>For output 405 (4 to 20 mA)<br>For output 410<br>(4 to 20 mA with HART)<br>Jump response time $T_{60}$<br>Attenuation | 4 to 20 mA, two-wire<br>4 to 20 mA, two-wire with HART version 7<br><br>$\leq 190$ ms without attenuation<br>Adjustable 0 to 100 s                                                    |
| Burden<br>For output 405 (4 to 20 mA)<br>For output 410<br>(4 to 20 mA with HART)                                                      | $\text{Burden} \leq (U_B - 12 \text{ V}) \div 0.022 \text{ A}$<br>$\text{Burden} \leq (U_B - 12 \text{ V}) \div 0.022 \text{ A}$ ; additional: min. 250 $\Omega$ , max. 1100 $\Omega$ |

### 4.6 Environmental influences

|                                                                                                           |                                                                                    |                   |                            |                                  |                                                                  |
|-----------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------|-------------------|----------------------------|----------------------------------|------------------------------------------------------------------|
| Admissible temperatures<br>Operation                                                                      | Version                                                                            | Temperature class | Maximum medium temperature | Ambient temperature <sup>a</sup> | Expanded ambient temperature (extra code 681) <sup>a, b, c</sup> |
|                                                                                                           | Standard                                                                           |                   | 120 °C                     | -40 to +85 °C                    | -50 to +85 °C                                                    |
|                                                                                                           | High temperature                                                                   |                   | 200 °C                     | 10 to 85 °C <sup>d</sup>         | –                                                                |
|                                                                                                           | II 1/2G Ex ia                                                                      | T6                | 60 °C                      | -40 to +50 °C                    | -50 to +50 °C                                                    |
|                                                                                                           |                                                                                    | T5                | 70 °C                      | -40 to +65 °C                    | -50 to +65 °C                                                    |
|                                                                                                           |                                                                                    | T4                | 115 °C                     | -40 to +85 °C                    | -50 to +85 °C                                                    |
|                                                                                                           |                                                                                    | T3 <sup>e</sup>   | 175 °C                     | 10 to 85 °C                      | –                                                                |
|                                                                                                           | II 1/2D Ex ia                                                                      | T105 °C           | 100 °C                     | -40 to +60 °C                    | -50 to +60 °C                                                    |
| Storage                                                                                                   | -40 to +85 °C                                                                      |                   |                            |                                  |                                                                  |
| Admissible humidity<br>Operation<br>Storage                                                               | 100 % including condensation on the device outer case<br>90 % without condensation |                   |                            |                                  |                                                                  |
| Admissible mechanical load<br>Vibration strength<br>Shock resistance                                      | DIN EN 60068-2-6, IEC 60068-2-27<br>2 g, 10 to 2000 Hz<br>15 g for 6 ms            |                   |                            |                                  |                                                                  |
| Electromagnetic compatibility<br>Interference emission<br>Interference immunity                           | DIN EN 61326-2-3:2022<br>Class B <sup>f</sup><br>Industry                          |                   |                            |                                  |                                                                  |
| Protection type<br>For version<br>Explosion protection 0 (without)<br>Explosion protection 1 (ATEX Ex ia) | DIN EN 60529<br><br>IP66/67<br>IP66                                                |                   |                            |                                  |                                                                  |

<sup>a</sup> Under -20 °C limited function: stationary use, increased danger of cable break, display without function; under -30 °C operation of the device not possible.

<sup>b</sup> In the range from -40 to -50 °C the device must be permanently in operation. The lid with the inspection glass must also be protected against mechanical impact and shock effects.

<sup>c</sup> Without SIL.

<sup>d</sup> Low ambient temperatures up to -40 °C are possible, but with limited accuracy.

<sup>e</sup> Only for high-temperature version (medium temperature 2).

<sup>f</sup> The product is suitable for industrial use as well as for households and small businesses.

## 4 Technical data

### 4.7 Mechanical features

|                                                                                                                                                                                                                                                                                                                                                                                                                                     |                                                                                                                                                        |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------|
| Process connection<br>Material 20 (stainless steel)<br>For front-flush process connections<br>Otherwise<br>Material 82 (HASTELLOY)<br>Surface                                                                                                                                                                                                                                                                                       | 316L<br><br>316Ti<br>2.4819/HASTELLOY C-276<br>Ra ≤ 0.8 µm                                                                                             |
| Process seal<br>Process connection 571<br>G 3/4 front-flush) and<br>process connection 652<br>(tank connection with grooved<br>union nut)<br>Process connection 997<br>(JUMO PEKA)<br>Otherwise                                                                                                                                                                                                                                     | FPM<br><br><br>FDA compliant, see data sheet 409711<br><br>No seal                                                                                     |
| Measuring membranes<br>Material process connection 20<br>(stainless steel)<br>For -1 to +250 bar relative<br>pressure (measuring range<br>508)<br>For -1 to +600 bar relative<br>pressure (measuring range<br>516)<br>Otherwise<br>Material process connection 82<br>Surface                                                                                                                                                        | 630<br><br>630<br><br>316L<br>2.4819/HASTELLOY C-276 <sup>a</sup><br>Ra ≤ 0.8 µm                                                                       |
| Housing<br>Material<br>Housing 1 (short, stainless<br>steel)<br>Housing 2 (long, stainless<br>steel)<br>Housing 3 (precision casting)<br>Lid 20 (stainless steel)<br>Lid 85 (plastic)<br>Electrical connection 36<br>(plug connector M12)<br>Electrical connection 82<br>(cable fitting, plastic)<br>Electrical connection 93<br>(cable fitting, metal)<br>Operation 0 (without control<br>knob)<br>Operation 1 (with control knob) | 1.4404<br><br>1.4404, VMQ<br><br>1.4408<br>1.4408, seal FPM<br>PA, seal FPM<br>Brass nickel-plated<br><br>PA<br><br>Brass nickel-plated<br><br>–<br>PA |
| Weight                                                                                                                                                                                                                                                                                                                                                                                                                              |                                                                                                                                                        |

|                                               |          |
|-----------------------------------------------|----------|
| Type 403025/0-0-1 (housing short)             | ~ 550 g  |
| Type 403025/0-0-2 (housing long)              | ~ 850 g  |
| Type 403025/0-0-3 (housing precision casting) | ~ 1600 g |

<sup>a</sup> Not available in high-temperature version.

### 4.7.1 Process connections

#### Front-flush

| Designation                                     | Max. pressure | Temperature range |
|-------------------------------------------------|---------------|-------------------|
| Taper socket with union nut DN 25<br>DIN 11851  | 40 bar        | -10 to +140 °C    |
| Taper socket with union nut DN 40<br>DIN 11851  | 40 bar        | -10 to +140 °C    |
| Tank connection with grooved<br>union nut DN 40 | 25 bar        | Up to 150 °C      |
|                                                 | 40 bar        | Up to 100 °C      |
| G 3/4 front-flush<br>DIN EN ISO 228-1           | 25 bar        | -10 to +150 °C    |
|                                                 | 40 bar        | -10 to +100 °C    |

#### Front-flush, with EHEDG certification

| Designation                                              | Max. pressure | Temperature range |
|----------------------------------------------------------|---------------|-------------------|
| Clamping socket (clamp) DN 25<br>DIN 32676               | 25 bar        | -10 to +140 °C    |
| Clamping socket (clamp) DN 50<br>DIN 32676 (2" ISO 2852) | 16 bar        | -10 to +140 °C    |
| JUMO PEKA –<br>Hygienic process connection               | 25 bar        | -10 to +200 °C    |
|                                                          | 40 bar        | -10 to +100 °C    |

## 4 Technical data

### 4.8 Approval marks and certificates

|                                                                                     |                  |                                                                                                            |
|-------------------------------------------------------------------------------------|------------------|------------------------------------------------------------------------------------------------------------|
|    | Designation      | ATEX                                                                                                       |
|                                                                                     | Testing agency   | Eurofins Electrosuisse Product Testing AG                                                                  |
|                                                                                     | Certificate no.  | SEV 09 ATEX 0138 X                                                                                         |
|                                                                                     | Inspection basis | EN 60079-0, EN 60079-11, EN 60079-26                                                                       |
|                                                                                     | Valid for        | Type 403025/x-1                                                                                            |
|                                                                                     | Designation      | UKEX                                                                                                       |
|                                                                                     | Testing agency   | Bureau Veritas                                                                                             |
|                                                                                     | Certificate no.  | EPS 22 UKEX 1 369 X                                                                                        |
|                                                                                     | Inspection basis | EN 60079-0, EN 60079-11, EN 60079-26                                                                       |
|                                                                                     | Valid for        | Type 403025/x-1 with extra code 085                                                                        |
|    | Designation      | DNV                                                                                                        |
|                                                                                     | Testing agency   | DNV                                                                                                        |
|                                                                                     | Certificate no.  | TAA00001KB                                                                                                 |
|                                                                                     | Inspection basis | DNV GL CG-0339                                                                                             |
|                                                                                     | Valid for        | Type 403025/x-1 with extra code 880                                                                        |
|    | Designation      | SIL                                                                                                        |
|                                                                                     | Testing agency   | exida                                                                                                      |
|                                                                                     | Certificate no.  | JUMO 2203088 C001                                                                                          |
|                                                                                     | Inspection basis | IEC 61508-1/-2/-3:2010                                                                                     |
|                                                                                     | Valid for        | Type 403025 with basic type extension 2                                                                    |
|  | Designation      | EHEDG                                                                                                      |
|                                                                                     | Testing agency   | EHEDG                                                                                                      |
|                                                                                     | Certificate no.  | EHEDG-C2000058                                                                                             |
|                                                                                     | Inspection basis | Hygienic Equipment Design                                                                                  |
|                                                                                     | Valid for        | JUMO PEKA – Hygienic process connection with FPM O-ring, process connection 613 and process connection 616 |
|  | Designation      | H2 ready – Mobile hydrogen applications                                                                    |
|                                                                                     | Testing agency   | KIWA                                                                                                       |
|                                                                                     | Certificate no.  | P000415366HGV19                                                                                            |
|                                                                                     | Inspection basis | CSA ANSI HGV 3:1:2022                                                                                      |
|                                                                                     | Valid for        | Type 403025 with extra code 1160                                                                           |


Observe "Special conditions for safe use" in hazardous areas.

Certificates for approved device versions are available for download on the manufacturer's website.


EHEDG conformity only in conjunction with EHEDG-approved process connections, ⇨ page 25.

### 4.9 Dimensions

Type 403025/0-0-1 (short, stainless steel, with M12 plug connection)

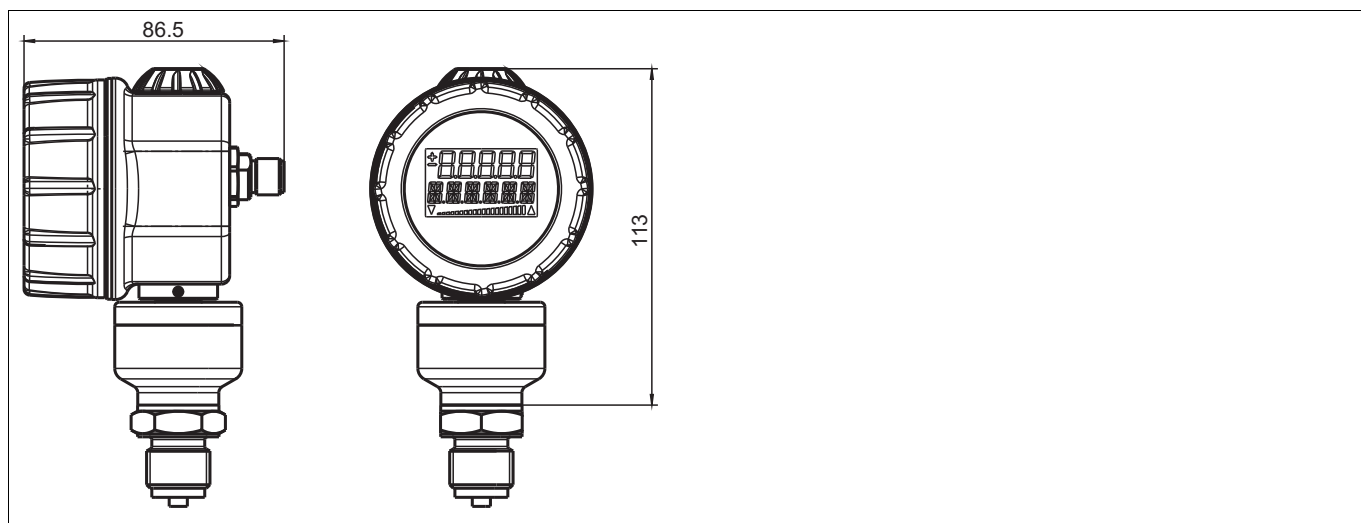


Type 403025/0-0-2 (long, stainless steel, with cable fitting)

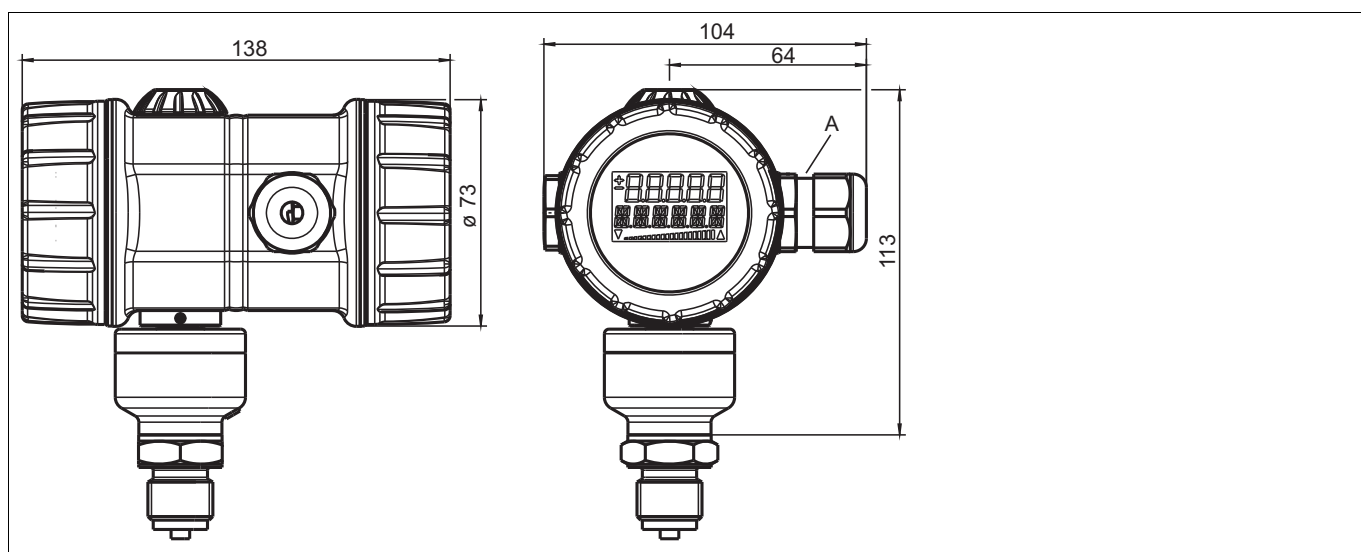

A M20 × 1.5 cable fitting

## 4 Technical data


Type 403025/0-0-3 (precision casting, with cable fitting)

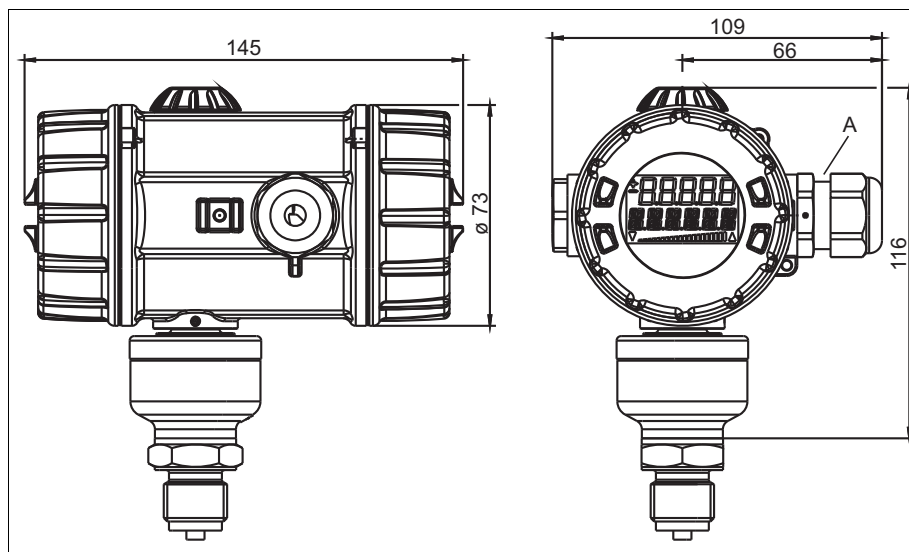

A M20 × 1.5 cable fitting

### Device in high-temperature version (medium temperature 2)

Pressure transmitters that are suitable for medium temperatures up to 200 °C have an extended shaft through which the increased temperature is discharged. The total height of all pressure transmitters in this version increases by 41 mm as shown in the following figure.

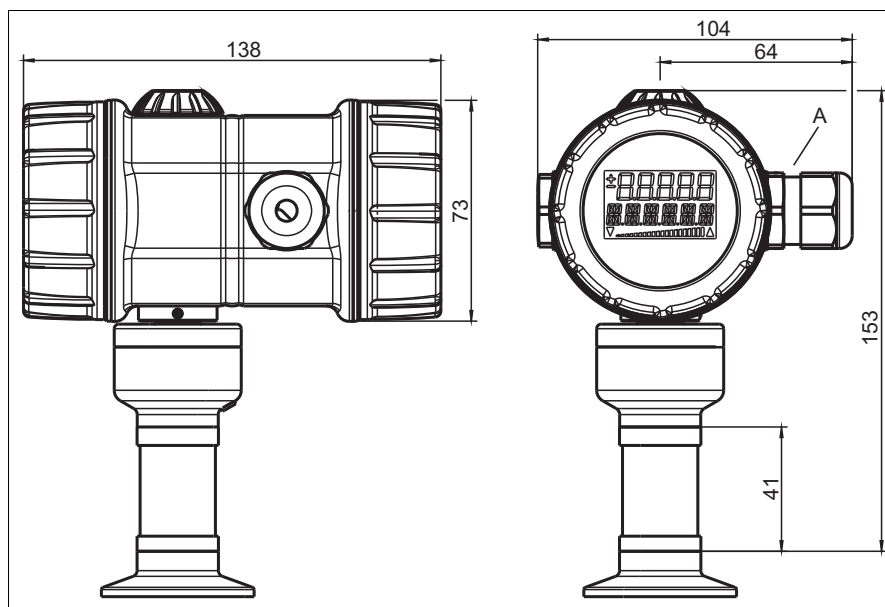


A M20 × 1.5 cable fitting


## 4.9.1 Process connections

### Not front-flush


G 1/2  
DIN EN 837

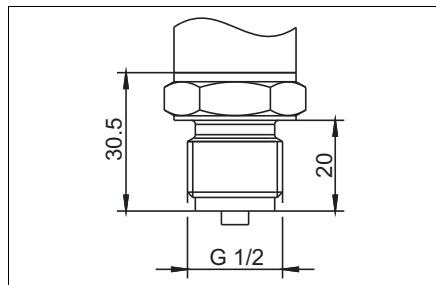


1/2" – 14 NPT  
DIN EN 837

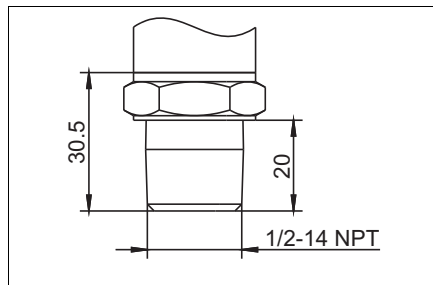

1/2" – 14 NPT internal

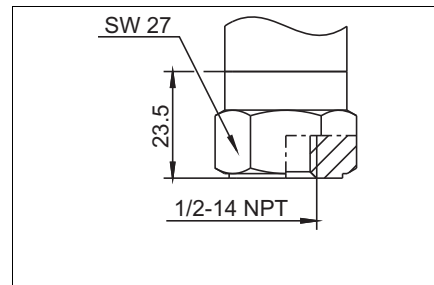


M20 (× 1.5) with pin

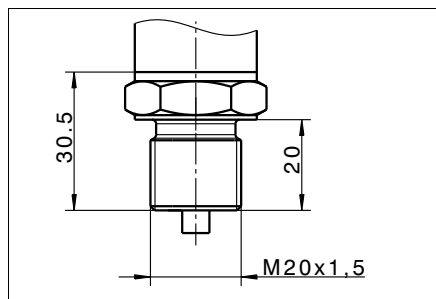


### Front-flush


Tank connection with grooved union  
nut DN 40

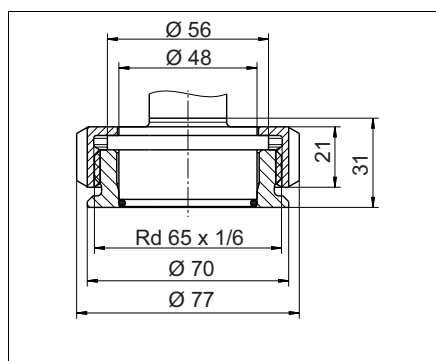

Taper socket with union nut  
DIN 11851

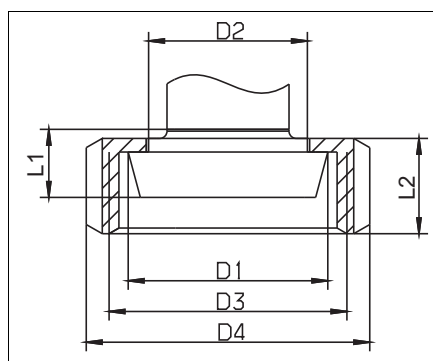

G 3/4  
DIN EN ISO 228-1

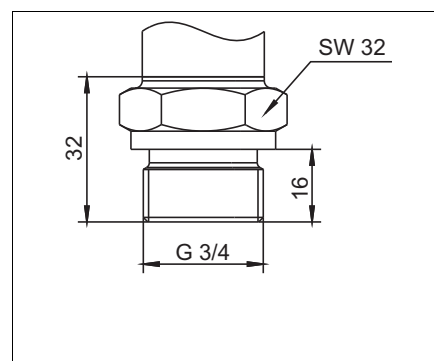



| Connection                               | DN | D1   | D2   | D3           | D4   | L1 | L2 |
|------------------------------------------|----|------|------|--------------|------|----|----|
| Taper socket with union nut<br>DIN 11851 | 25 | Ø 44 | Ø 35 | Rd 52 × 1/6" | Ø 63 | 15 | 21 |
|                                          | 40 | Ø 56 | Ø 48 | Rd 65 × 1/6" | Ø 78 |    |    |

# 4 Technical data

## Front-flush, with EHEDG certification

JUMO PEKA –  
Hygienic process connection

Clamping socket (clamp)  
DIN 32676

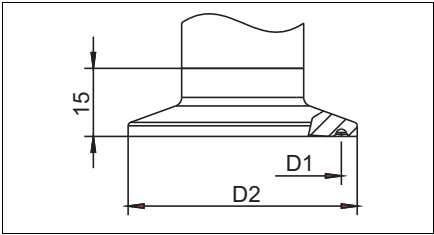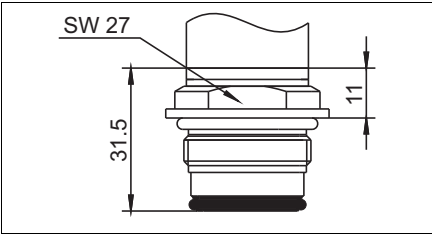

| Connection              | DN | D1     | D2     |
|-------------------------|----|--------|--------|
| Clamping socket (clamp) | 25 | Ø 43,5 | Ø 50.5 |
| DIN 32676               | 50 | Ø 56,5 | Ø 64   |

### 5.1 Before mounting



#### **DANGER!**

**Depressurize the plant before installing the device!**

**The device may only be opened in the potentially explosive area when disconnected from the power supply!**



#### **NOTE!**


Select a freely accessible and low-vibration installation location, preferably near the measuring point. Ensure that the admissible ambient temperature is adhered to (take possible heat radiation into account).

The device can be installed above or below the pressure sensing point.

### 5.2 Unscrew the front ring or case lid

#### **Plastic lid**


The bezel (1) and the rear case lid (2) can be removed.

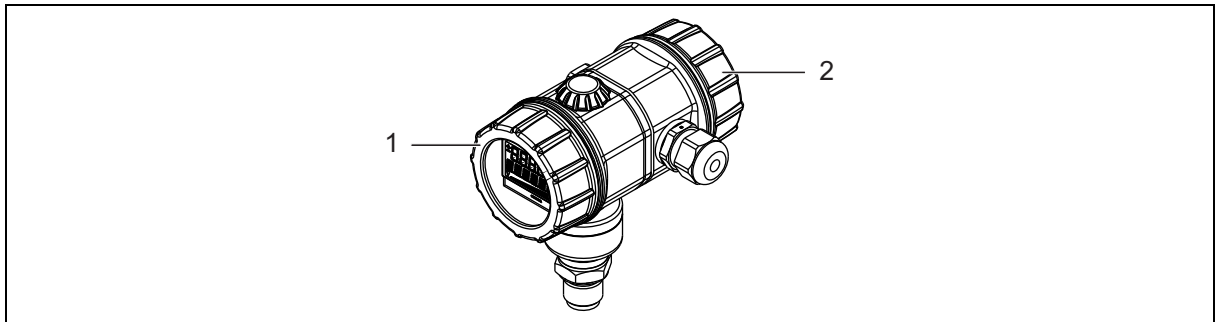

- 1 Bezel (plastic)
- 2 Case lid (plastic)

## 5 Mounting

The bezel and the rear case lid can be removed using a screwdriver, or similar.

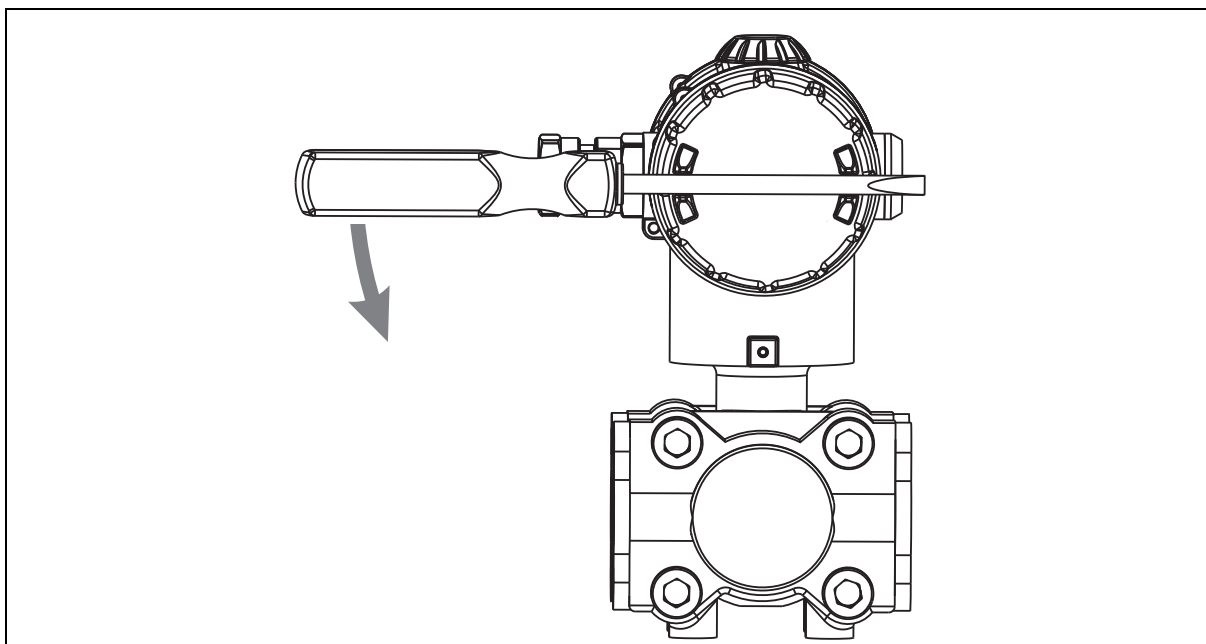


### NOTE!

Only tighten by hand!


### 5.3 Rotating the LCD (display)

#### Installation position

The rated position of the device is vertically upright.

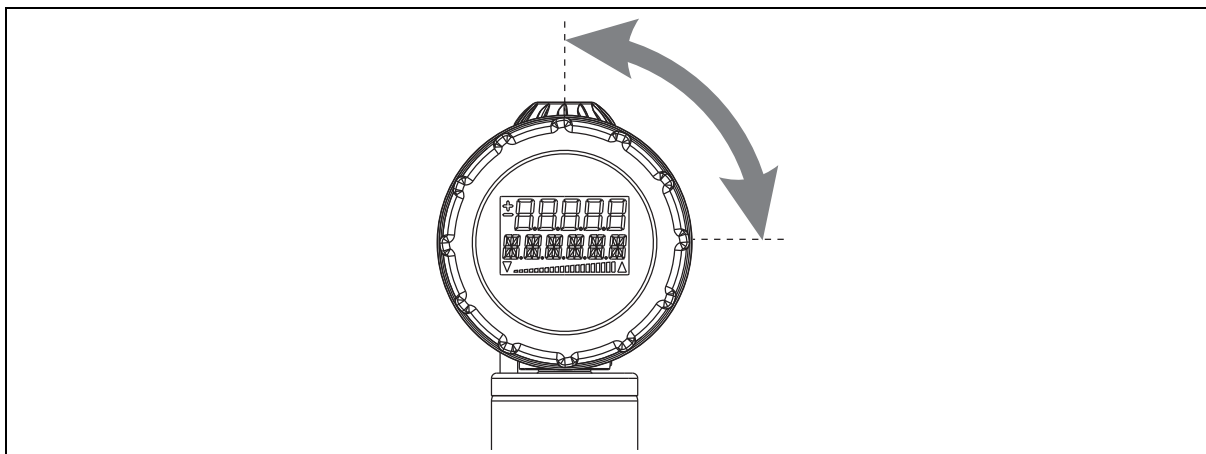


Depending on the conditions of the measuring point, the device can be installed in any other position. The LCD display can be rotated in 90° steps depending on the desired installation position.

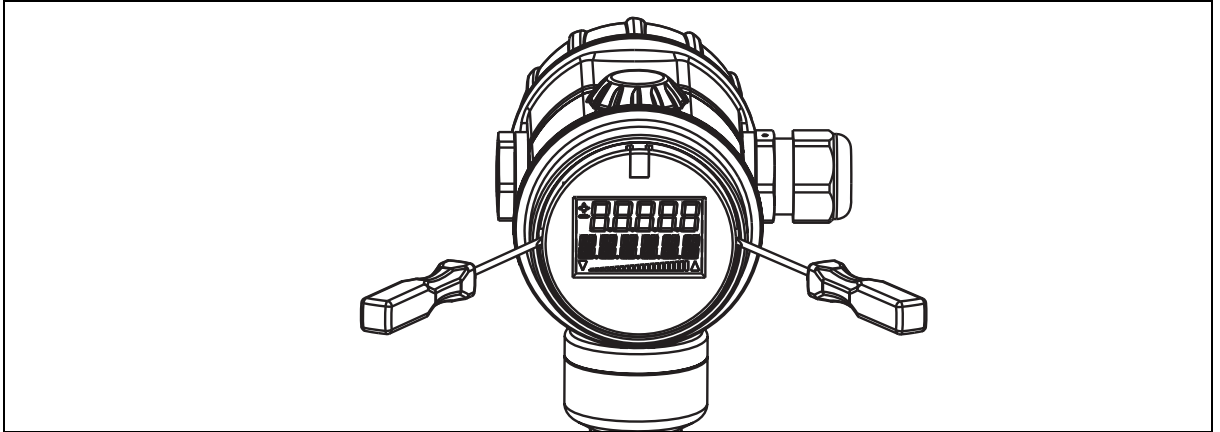

1. To unscrew the bezel, see chapter 5.2 "Unscrew the front ring or case lid", Page 27.
2. Lift out the electronics module using a narrow (small) screwdriver.
3. Rotate the electronics module into the desired position (90° steps) and insert again.
4. Screw on the bezel so that it is hand-tight.

### 5.4 Rotating the housing

The housing can be rotated by  $\pm 160^\circ$ .

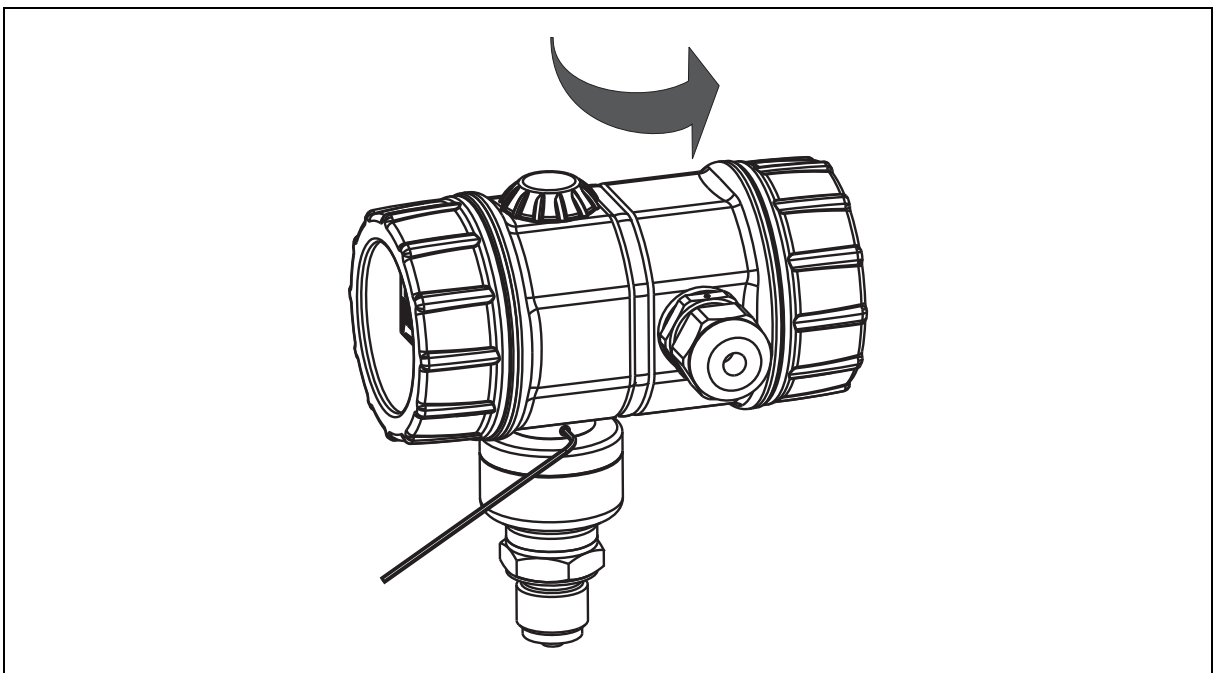


1. Loosen the threaded pin using a 1.5 mm hex wrench.
2. Rotate the housing to the desired position.
3. Screw on the threaded pin again until it is **tight**.

# 5 Mounting

---

## 5.5 Pressure connection

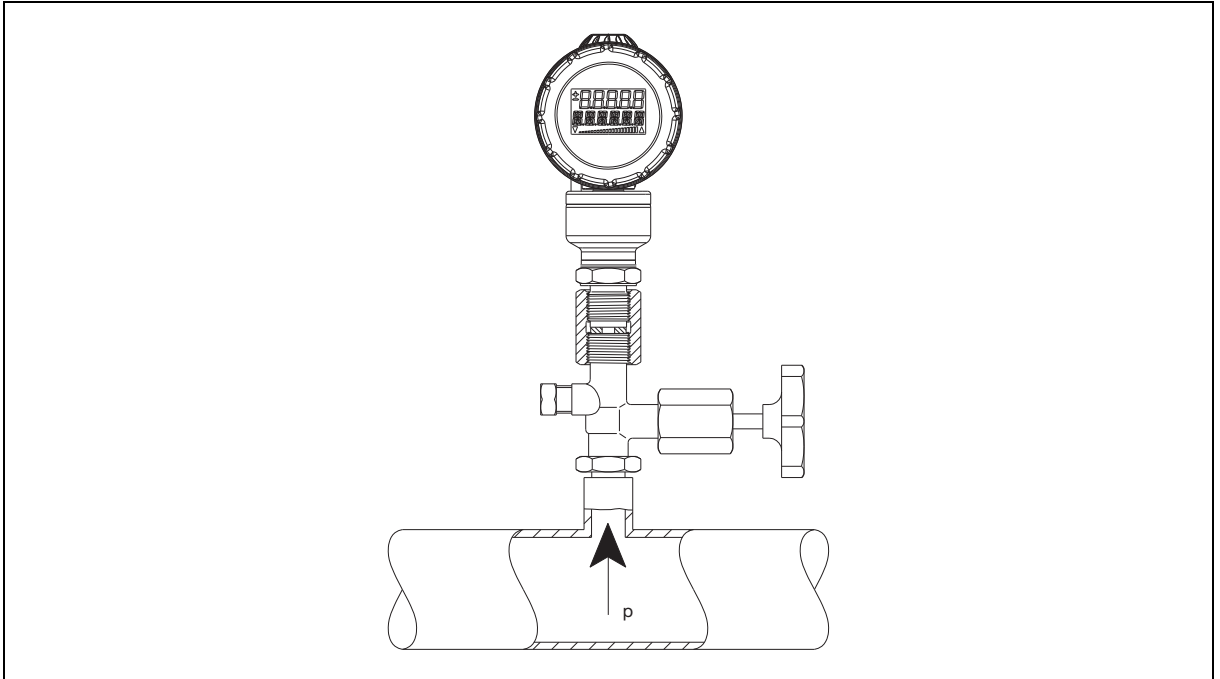

### Seals

Operating conditions (for example material compatibility) must be considered when selecting the seal.

### Tightening torques

Maximum 200 Nm

The correct tightening torque depends on the size, material and shape of the seal that is used and the pressure connection of the device.

### Checking for seal tightness

The pressure connection must be checked for seal tightness once established.



### CAUTION!

**If shut-off valves are used incorrectly, this can lead to personal injury or significant material damage!**

Observe the correct order when opening or closing the valves!

► The device must not be vented when **used in toxic media!**



### NOTE!

Depending on the system configuration, the following examples must be adapted to meet requirements!




### NOTE!

Mount the device so that abrasion at the process connection is avoided.


## 5.6 Measuring the relative or absolute pressure

### Gases

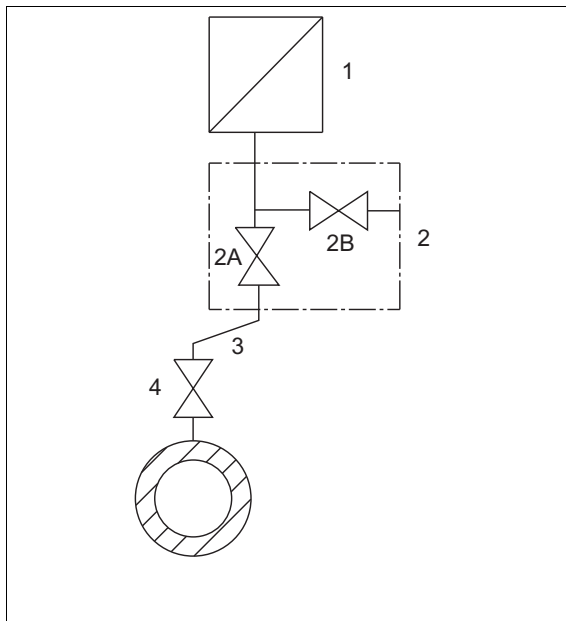

Transmitter **above** the pressure sensing point (normal arrangement)

- 1 Transmitter
- 3 Pressure pipe
- 5 Shut-off valve (optional)
- 7 Drain valve

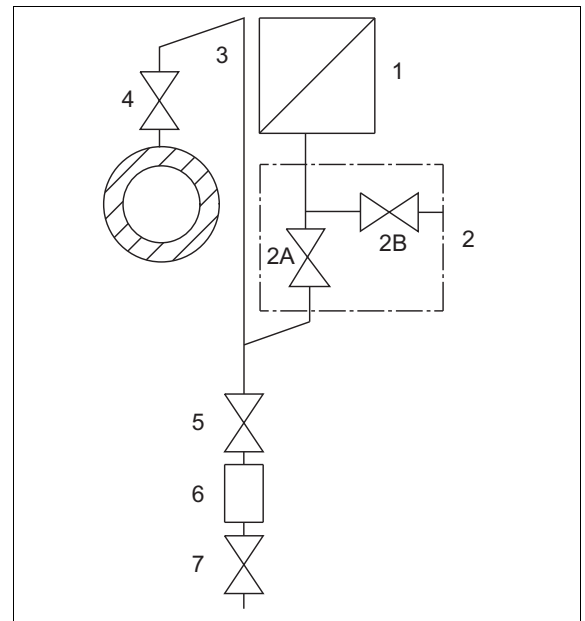

Transmitter **below** the pressure sensing point (exception)

- 2 Shut-off valve
- 2 A shut-off valve for processing
- 2 B shut-off valve for test connection
- 4 Shut-off valve
- 6 Condenser vessel (optional)

### Pressurization


**Start position:** all valves closed

**Operate shut-off valves in the following order:**

1. Open shut-off valve (4) on the pressure relief support.
2. Open shut-off valve (2 A).
3. Note down the pressure value and mA value displayed on the device.
4. Close shut-off valve (2 A).
5. Open shut-off valve (2 B).
6. Enter the same pressure value via the shut-off valve (2) test connection on the device.
7. Compare the pressure value and mA value displayed on the device with the values noted under 3. Correct the device as required, see chapter 7.3.2 "The parameter level", Page 48.
8. Close shut-off valve (2 B).
9. Open shut-off valve (2 A).

## 5 Mounting

### Steam

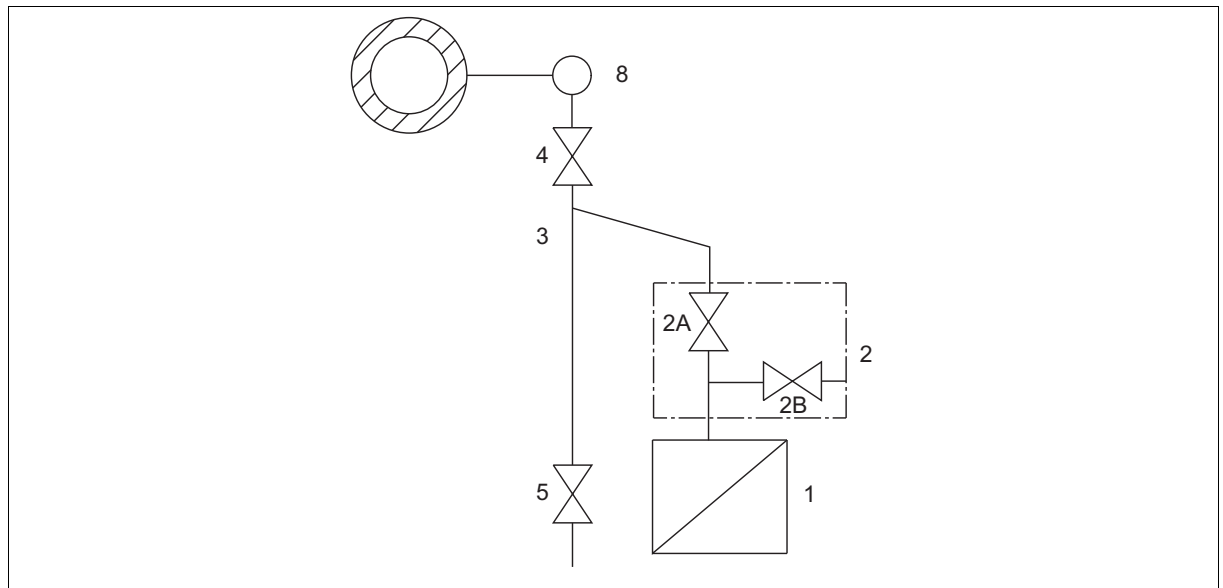

|   |                |   |                                        |
|---|----------------|---|----------------------------------------|
| 1 | Transmitter    | 2 | Shut-off valve                         |
|   |                |   | 2 A shut-off valve for processing      |
|   |                |   | 2 B shut-off valve for test connection |
| 3 | Pressure pipe  | 4 | Shut-off valve                         |
| 5 | Blow-off valve | 8 | Compensating vessel                    |


### Pressurization

**Start position:** all valves closed

**Operate shut-off valves in the following order:**

1. Open shut-off valve (4) on the pressure relief support, and wait until the steam in the pressure pipe has condensed.
2. Open shut-off valve (2 A).
3. Note down the pressure value and mA value displayed on the device.
4. Close shut-off valve (2 A).
5. Open shut-off valve (2 B).
6. Open the drain/vent valve on the device (1) and drain the liquid.
7. Close the drain/vent valve on the device (1).
8. Enter the same pressure value via the shut-off valve (2) test connection on the device.
9. Compare the pressure value and mA value displayed on the device with the values noted under 3. Correct the device as required, see chapter 7.3.2 "The parameter level", Page 48.
10. Close shut-off valve (2 B).
11. Open shut-off valve (2 A).

### Liquids

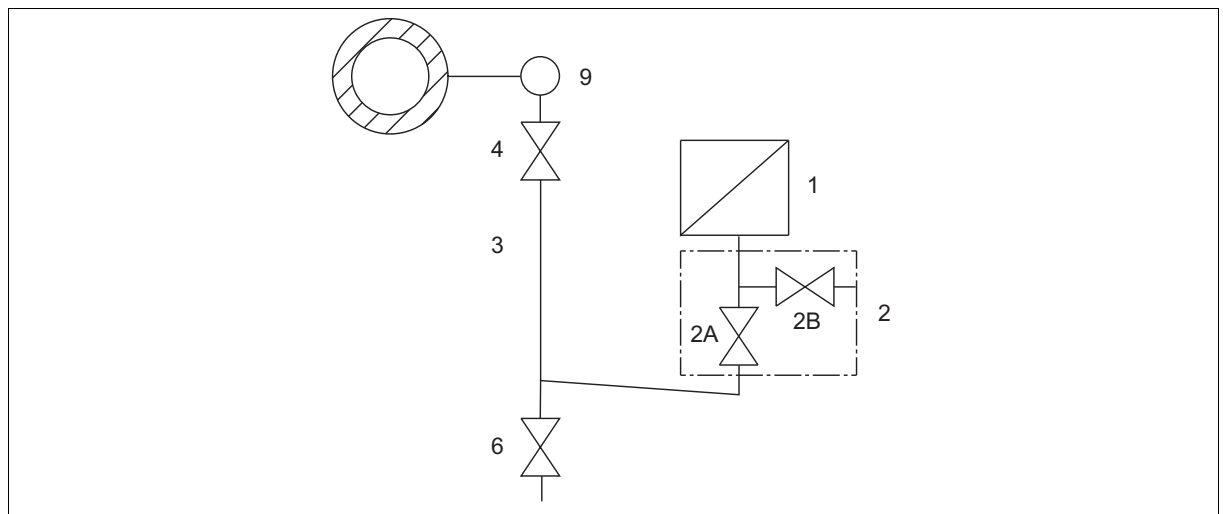

- |                    |                                                                                                   |
|--------------------|---------------------------------------------------------------------------------------------------|
| (1) Transmitter    | (2) Shut-off valve<br>2 A shut-off valve for processing<br>2 B shut-off valve for test connection |
| (3) Pressure pipe  | (4) Shut-off valve                                                                                |
| (5) Blow-off valve | (9) Compensating vessel                                                                           |

### Pressurization

**Start position:** all valves closed

**Operate shut-off valves in the following order:**

1. Open shut-off valve (4) on the pressure relief support.
2. Open shut-off valve (2 A).
3. Note down the pressure value and mA value displayed on the device.
4. Close shut-off valve (2 A).
5. Open shut-off valve (2 B).
6. Open the drain/vent valve on the device (1) and drain the liquid.
7. Close the drain/vent valve on the device (1).
8. Enter the same pressure value via the shut-off valve (2) test connection on the device.
9. Compare the pressure value and mA value displayed on the device with the values noted under 3. Correct the device as required, see chapter 7.3.2 "The parameter level", Page 48.
10. Close shut-off valve (2 B).
11. Open shut-off valve (2 A).


## 5 Mounting

---

### 5.7 Bracket for wall and pipe mounting

#### Mounting example

(Part no. 00597711)

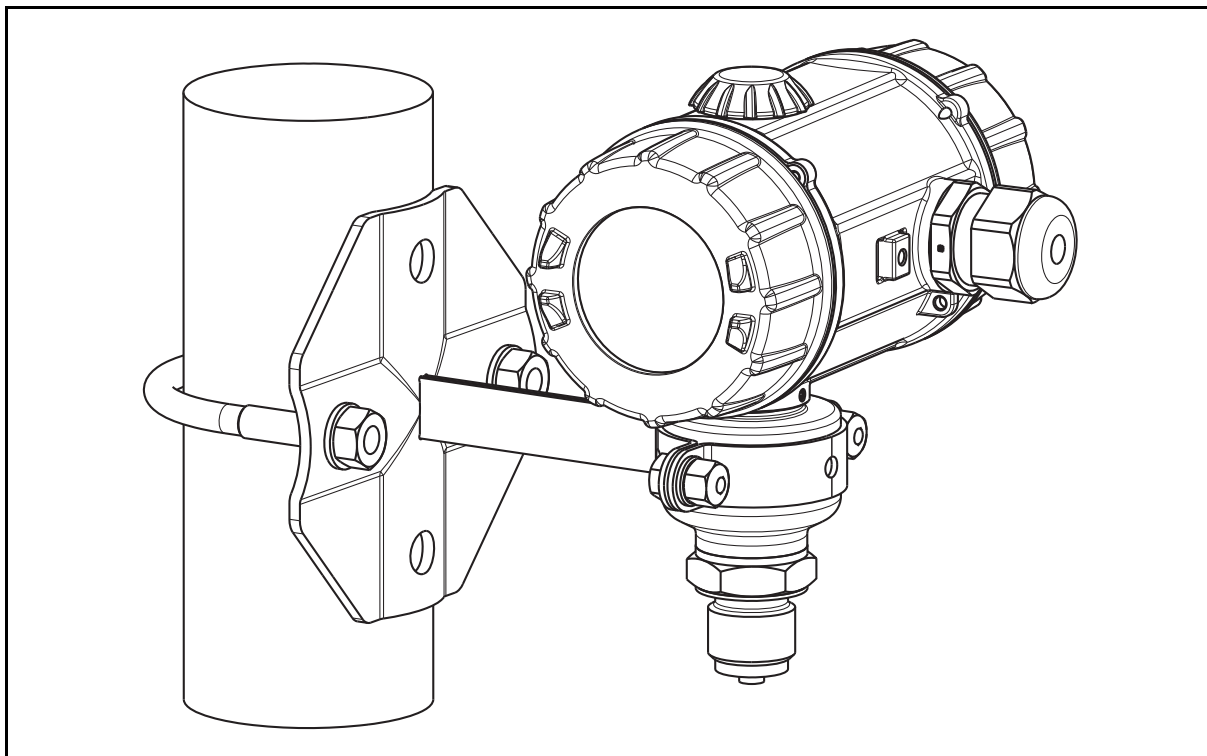


### 5.8 Level measurement with or without a pressure separator

The device is ideally suited for level measurements in open containers.

#### Mounting without a pressure separator

It is a good idea to mount cutters and drain valves in order to catch and remove deposits and pollutants. This makes it possible to remove the device even when the tank is full.

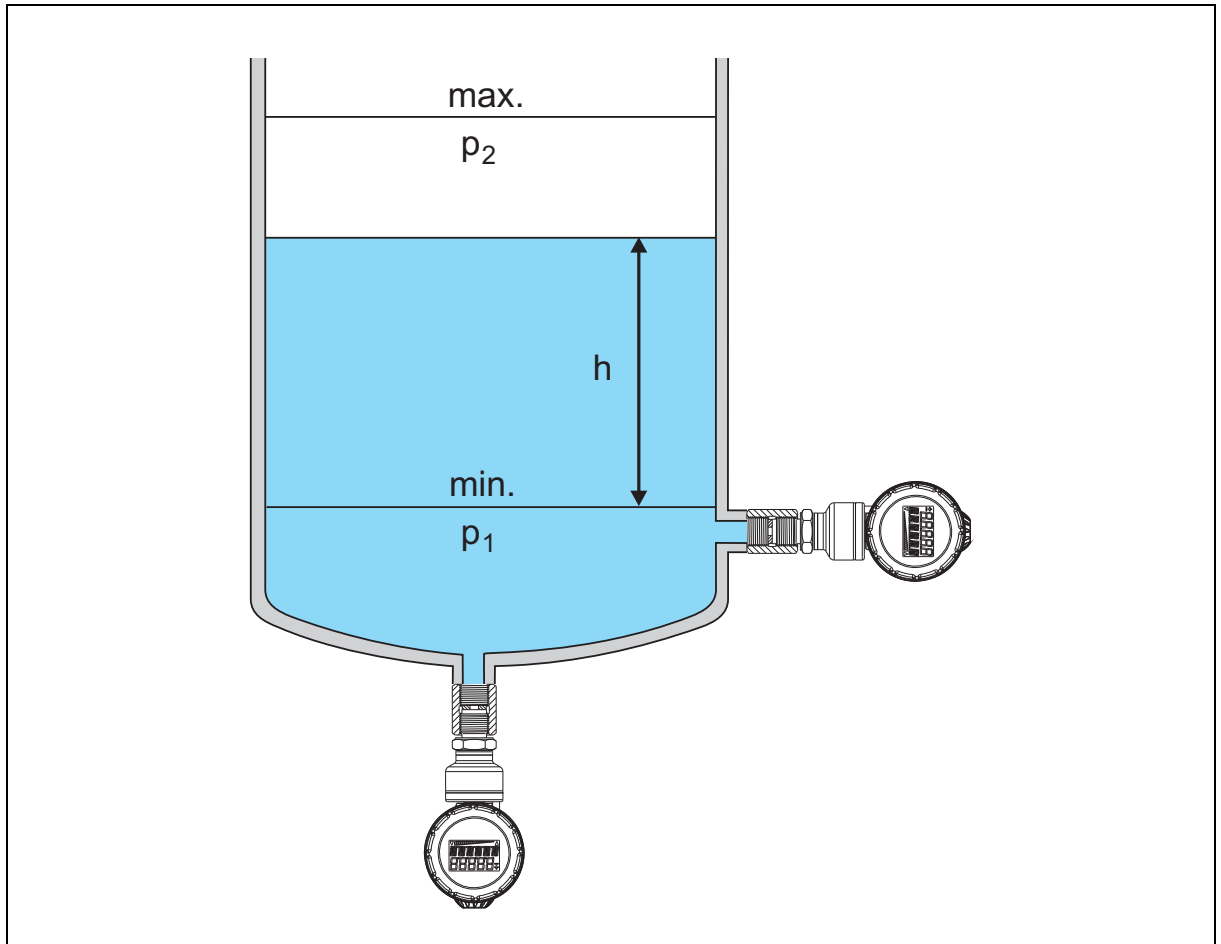

$h$  (filling level)      4 to 20 mA

#### 5.8.1 General information for a system with a diaphragm seal

A device with a capillary and diaphragm seals is a closed system that is filled with oil under vacuum.

- Remove membrane protection before installation
- Do not open closed system
- Do not touch or clean the diaphragm seal membranes with hard or sharp tools
- Bending radius of the capillaries:  $\geq 100$  mm

## 5 Mounting




### NOTE!

The filling oil influences the temperature application range and the response time of a pressure separator system. The medium and ambient temperature, as well as the process pressure are therefore decisive when selecting the filling oil.

Take note of the maximum possible temperature and pressures during commissioning/cleaning of the tank.

Pay attention to the tolerability of the filling oil with the requirements of the medium. For example, only filling oils that do not pose a health risk may be used in the food industry.

### 5.9 Assembly in the explosion area

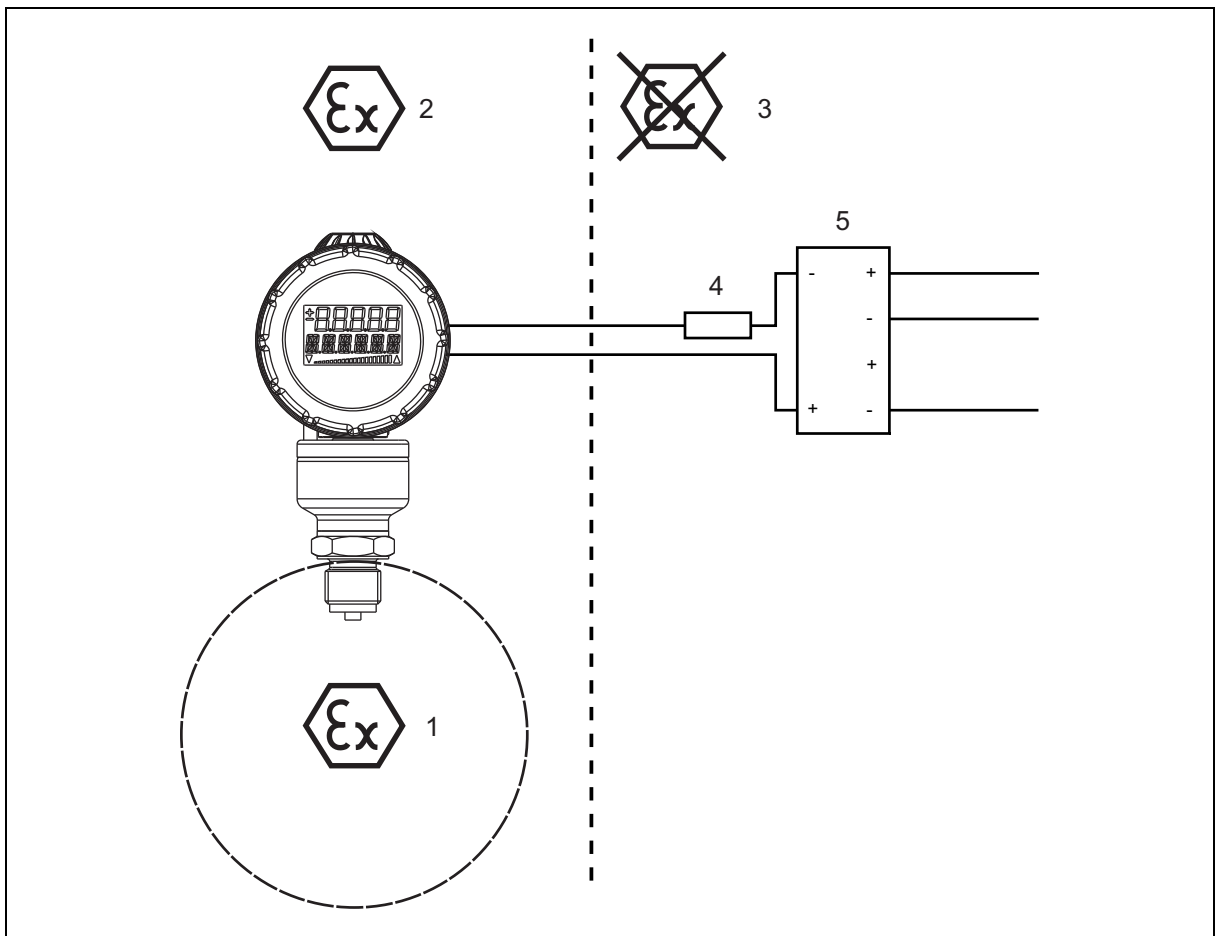

- 1 Potentially explosive area zone 0/20
- 2 Potentially explosive area zone 1/21
- 3 Non-potentially explosive area
- 4 Burden (optional for HART interface)
- 5 Power supply unit with an input isolating converter (see 707530) for connecting explosion-proof transmitters

## 6.1 Installation notes



### DANGER!

The electrical connection must only be carried out by qualified personnel.  
Ground the device!

The device must be completely disconnected from the mains voltage if there is a risk of contact with live parts during work on the equipment.

The electromagnetic compatibility meets standard EN 61326.

The device is suitable for use in SELV or PELV electrical circuits according to protection rating 3.

For connecting devices with Ex-approval, see chapter 6.4 "Electrical connection in Ex areas", Page 42.

In addition to a faulty installation, incorrectly set values could also impair the orderly function of the downstream process or lead to other damage.

### Conductor cross-sections and ferrules

|                                                      | Permissible cross-section                  |
|------------------------------------------------------|--------------------------------------------|
| <b>Without ferrule</b><br>(for rigid cable only)     | 0.2 to 1.5 mm <sup>2</sup><br>AWG 24 to 16 |
| <b>With ferrule</b><br>(for rigid or flexible cable) | 0.25 to 0.75 mm <sup>2</sup>               |

## 6.2 Device with cable gland

### General information




### DANGER!

For connection to devices in Ex areas see chapter 6.4 "Electrical connection in Ex areas", Page 42.

- Permissible cable diameter for devices with cable gland made of: 6 to 12 mm.
- Max. wire cross-section 1.5 mm<sup>2</sup>.
- Lay signal lines separate from cables with voltages of > 60 V.  
Use a shielded cable with twisted wires.  
Avoid the vicinity of large electrical systems.  
The full specification as per HART version 5.1, will only be achieved with a shielded cable.


## 6 Installation

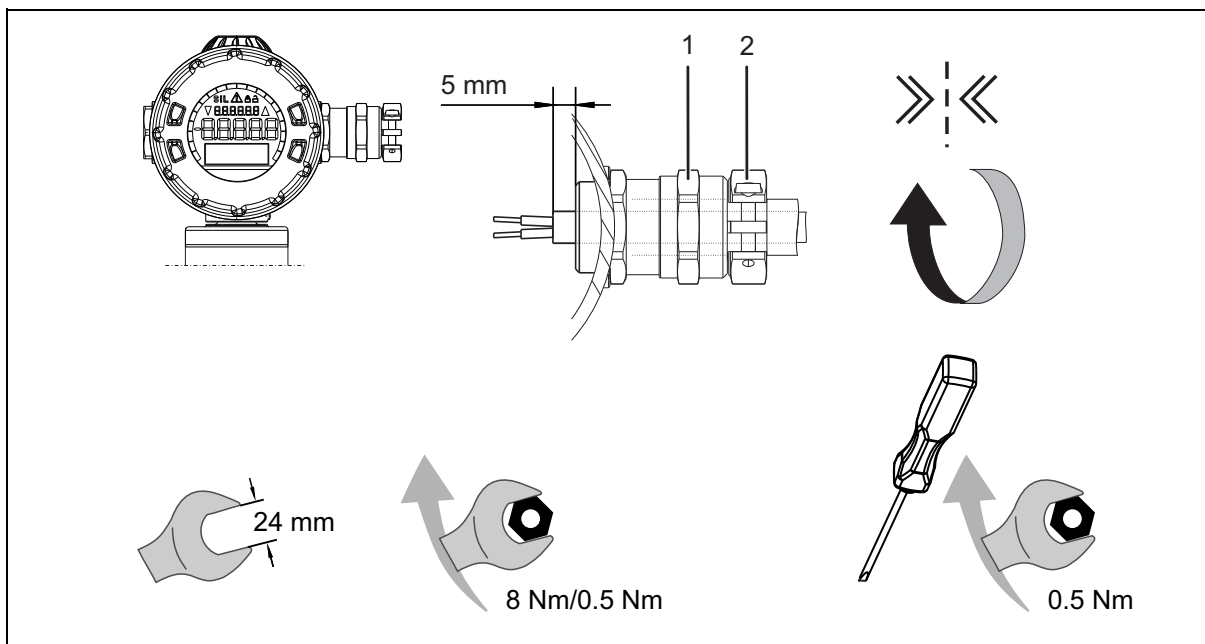

1. Insert the connection cable at least 5 mm into the housing.
2. Tighten the screw fitting by hand until you encounter resistance.
3. Tighten the screw connection (1) with a wrench:  
Plastic ~ 0.5 Nm  
Metal ~ 8 Nm
4. Tighten the strain relief (2) with a screwdriver.

### Connection


1. Unscrew the housing cover from behind, see chapter 5.2 "Unscrew the front ring or case lid", Page 27
2. Ground the device.
3. To connect the connecting cables, see the following illustration.

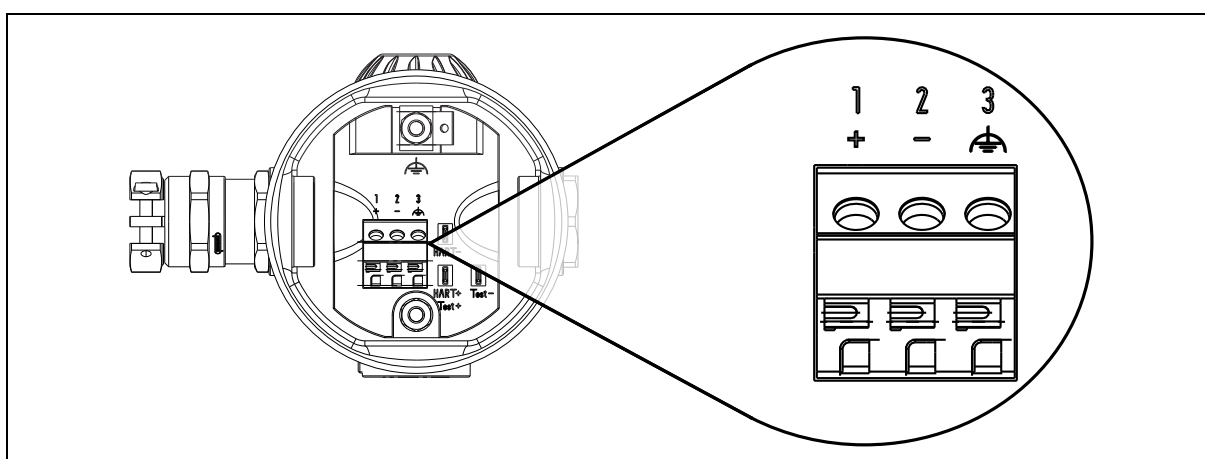

## Terminal assignment

| Connection                                                                                 |                                                                                   | Terminal assignment                          |
|--------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------|----------------------------------------------|
|                                                                                            |                                                                                   | 82 (plastic),<br>93 (metal)<br>Cable fitting |
| Voltage supply<br>DC 12 to 36 V for <b>non-Ex</b> -version<br>DC 12 to 28 V for Ex-version |  | 1 L+<br>2 L-                                 |
| Output<br>4 to 20 mA, 2-wire<br>Load-independent current: 4 to 20 mA<br>In voltage supply  |  | 1 L+<br>2 L-                                 |
| Test connection for current output<br>Internal resistance of the ammeter $\leq 10 \Omega$  |                                                                                   | TEST +<br>TEST -                             |
| Test connection for HART<br>The burden must be present!                                    |                                                                                   | HART +<br>HART -                             |
| Functional ground                                                                          |  | 3                                            |

## Operation and test

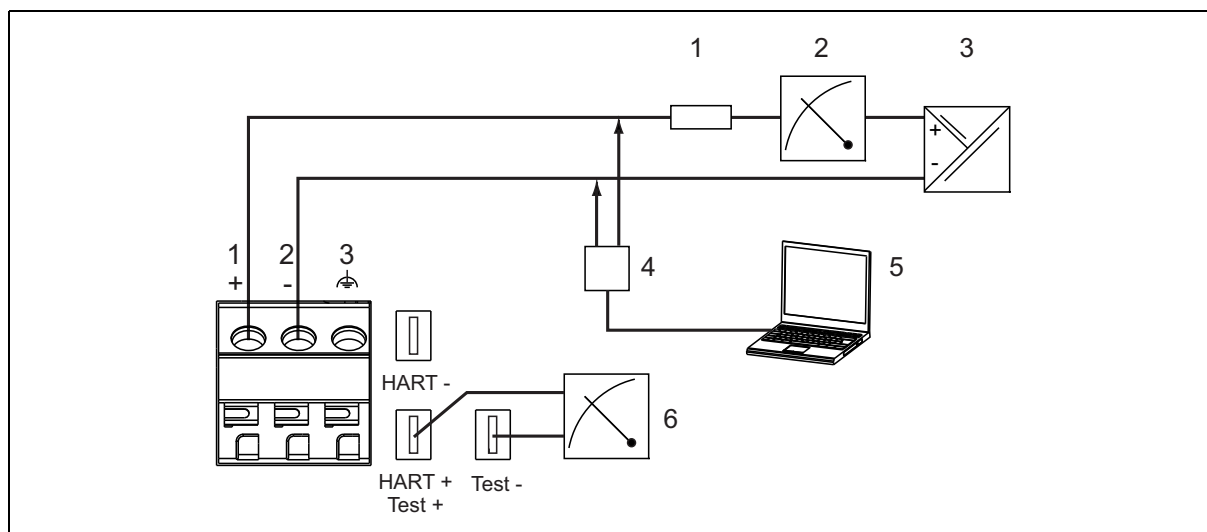

- 1 Total burden:  $\text{Burden} \leq (U_B - 12 \text{ V}) \div 0.022 \text{ A}$ ;  
for HART in addition: min. 250  $\Omega$ , max. 1100  $\Omega$
- 2 Display or recording device, controller, PLC, etc.
- 3 Voltage supply:  
for **non Ex** version DC 12 to 36 V  
for Ex version DC 12 to 28 V
- 4 HART modem
- 5 PC or Notebook
- 6 Inherent resistance of ammeter  $\leq 10 \Omega$

## 6 Installation


### 6.3 Device with M12 plug connector



#### **DANGER!**

For connection of the device in an Ex area see chapter 6.4 "Electrical connection in Ex areas", Page 42!

- Connect the device to ground using pin 4 of the device connector (1), see "Terminal assignment", Page 41.

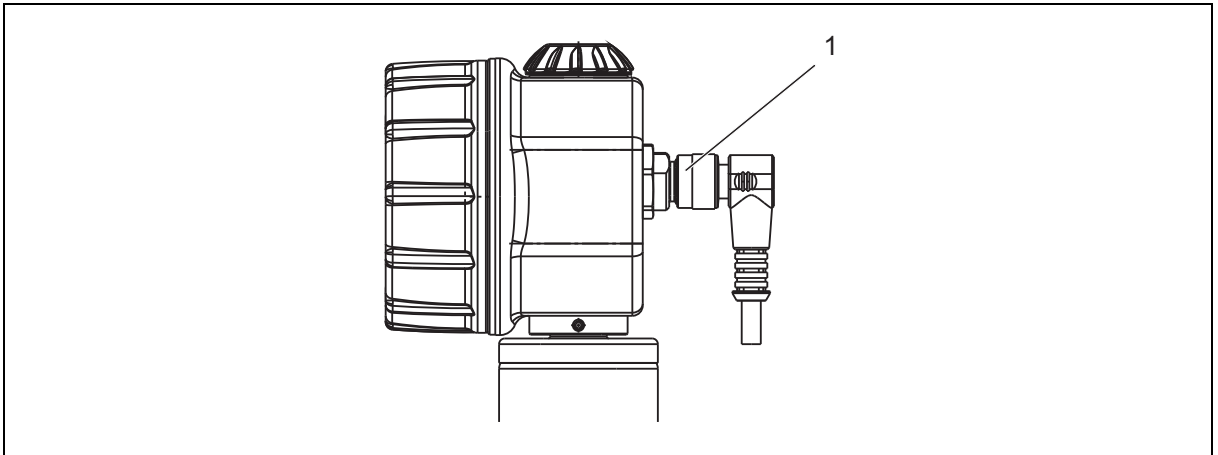

1 Device connector

A suitable connection is provided by a



- 4-pin cable box, straight, M12 × 1, with 2 m PVC cable, part no. 00404585, or a
- 4-pin cable box, angled, M12 × 1, with 2 m PVC cable, part no. 00409334, or a
- 5-pin cable box, straight, M12 × 1, without cable, part no. 00419130, or a
- 5-pin cable box, angled, M12 × 1, without cable, part no. 00419133

For pin configuration see below.

#### **General information**


- Lay signal lines separate from cables with voltages of > 60 V
- Use a shielded cable with twisted wires
- Avoid the vicinity of large electrical systems
- The full specification as per HART®, will only be achieved with a shielded cable.

## Terminal assignment

| Connection                                                                                 |                                                                                   | Terminal assignment      | Color coding <sup>a</sup> |
|--------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------|--------------------------|---------------------------|
|                                                                                            |                                                                                   | 36<br>round plug M12 × 1 |                           |
| Voltage supply<br>DC 12 to 36 V for <b>non-Ex</b> -version<br>DC 12 to 28 V for Ex-version |  | 1 L+<br>3 L-             | Brown<br>Blue             |
| Output<br>4 to 20 mA, 2-wire<br>Load-independent current: 4 to 20 mA<br>In voltage supply  |  | 1 L+<br>3 L-             | Brown<br>Blue             |
| Functional ground                                                                          |  | 4                        | Black                     |

<sup>a</sup> The color coding is only valid for A-coded standard cables!

## Operation

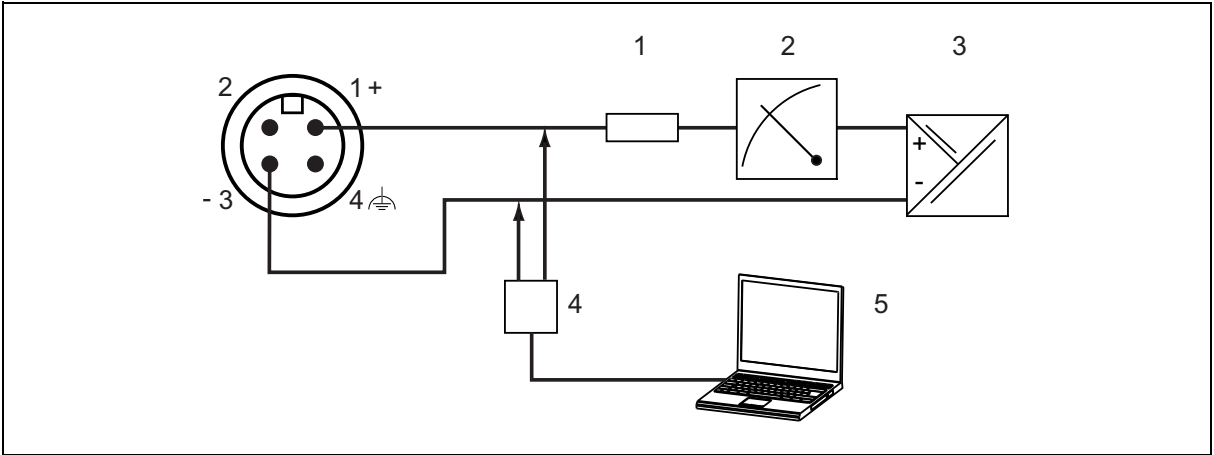

- 1 Total burden:  $\text{Burden} \leq (U_B - 12 \text{ V}) \div 0.022 \text{ A}$ ;  
for HART in addition: min. 250  $\Omega$ , max. 1100  $\Omega$
- 2 Display or recording device, controller, PLC, etc.
- 3 Voltage supply:  
for **non** Ex version DC 12 to 36 V  
for Ex version DC 12 to 28 V
- 4 HART modem
- 5 PC or Notebook

## 6 Installation

### 6.4 Electrical connection in Ex areas

#### General information

The relevant regulations must be observed during electrical connection; furthermore, in the potentially explosive area the minimum requirements according to Directive 1999/92/EC apply, for example:

- Regulation for the project planning, selection and installation of electrical plants in potentially explosive areas (IEC/EN 60079-14)
- EU type examination certificate



#### NOTE!

Only certified measuring devices may be used in intrinsically safe electrical circuits,!



#### NOTE!

The intrinsically safe electrical circuit must be restricted to overvoltage category I, as stipulated in IEC 60664-1. The electrical circuit supply is **only** to be provided by a certified, intrinsically safe power source with a protection level of "ia".



#### NOTE!


Hybrid mixtures are explosive mixtures of flammable gases, vapors, or mists with flammable dusts. In particular, equipment used in potentially explosive areas where hybrid mixtures are present must be checked. The operator is responsible for checking that the equipment is suitable for such uses.



#### DANGER!

**Only the HART modem may be used in the explosion-proof area!  
The JUMO interface must not be used!**

- The device's voltage supply must be intrinsically safe and must not exceed the following maximum values:  
U<sub>i</sub>: DC 28 V  
I<sub>i</sub>: 115 mA  
P<sub>i</sub>: 750 mW

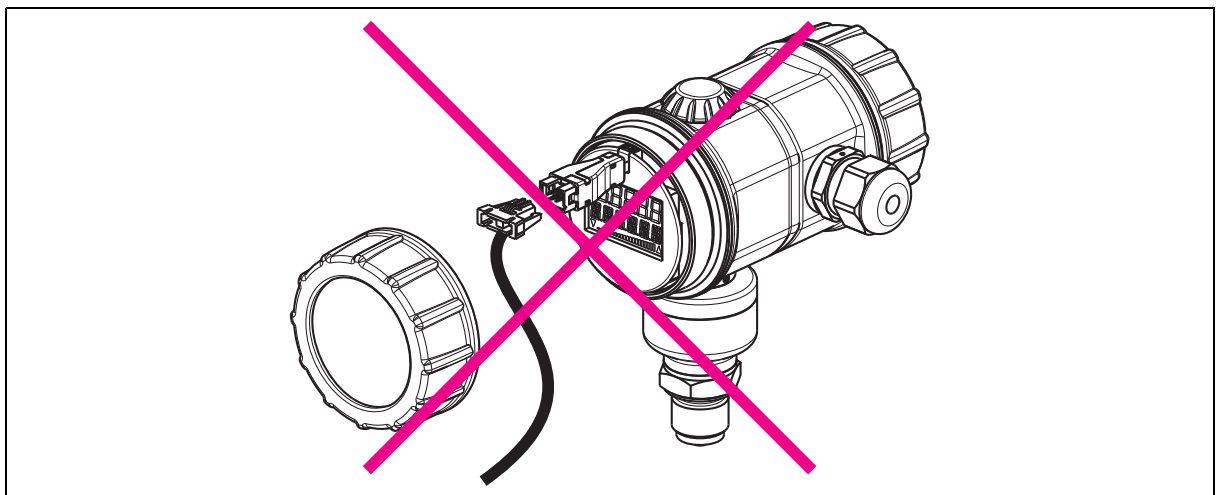




## NOTE!

Connecting the HART communicator or the HART modem is optional.  
A minimum burden must be present on the signal circuit in order to facilitate error-free communication, see the previous pages. The burden is usually already integrated when using input isolating amplifiers.


### 6.4.1 Connection diagram "Ex"

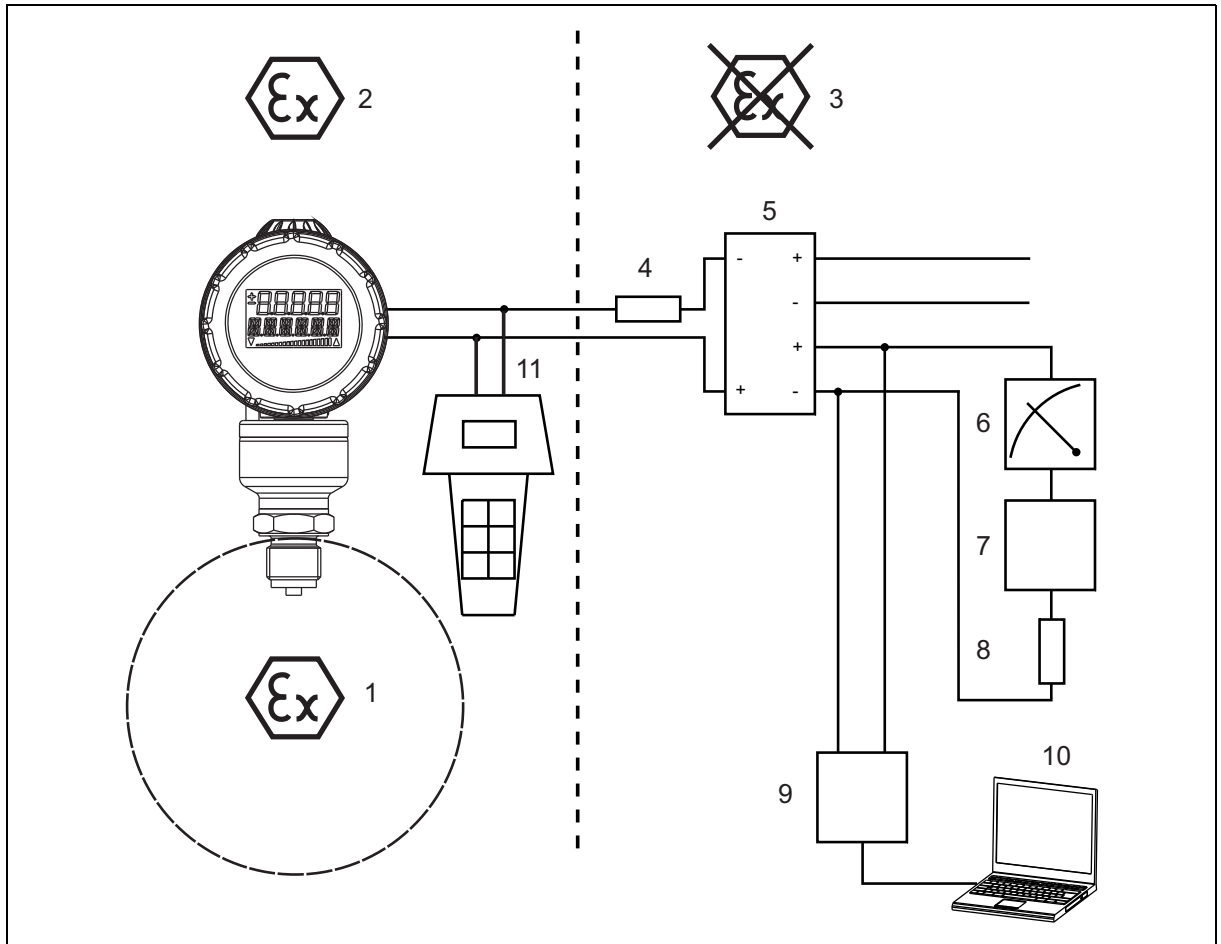

- 1 Potentially explosive area zone 0/20
- 2 Potentially explosive area zone 1/21
- 3 Non-potentially explosive area
- 4 Burden for HART  $\leq (U_B - 12 \text{ V}) \div 0.022 \text{ A}$ ;  
additional: min. 250  $\Omega$ , max. 1100  $\Omega$   
The current limiting resistor integrated in the power supply unit must be included in this calculation.
- 5 Power supply unit with an isolating converter for connecting explosion-proof transmitters
- 6 Indicating device or recorder, controller, PLC, etc.
- 7 Further devices
- 8 Burden for HART min. 250  $\Omega$ , max. 1100  $\Omega$   
The current limiting resistor integrated in the power supply unit must be included in this calculation.
- 9 HART modem
- 10 PC or notebook
- 11 HART communicator, intrinsically safe


## 7 Operation

### 7.1 Display

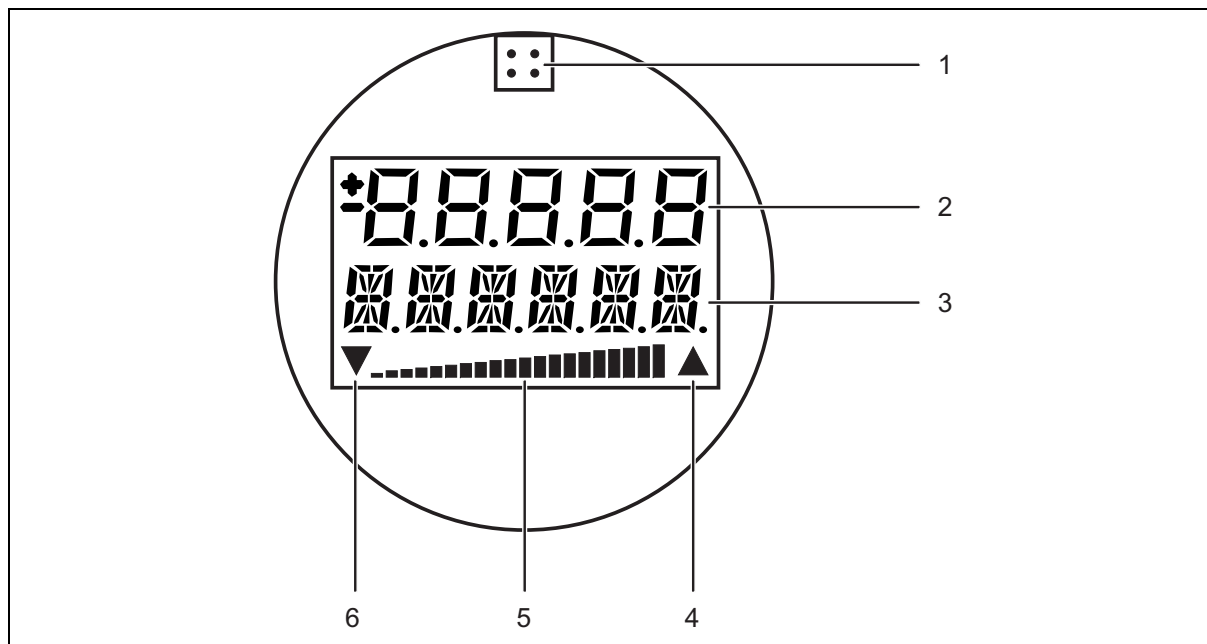

- 1 Socket for JUMO setup interface (behind a cover)
- 2 Measured value
- 3 Measuring unit
- 4 Overage
- 5 Percentage control of the measuring range
- 6 Underrange

### 7.2 Operation with rotary knob or with setup programm

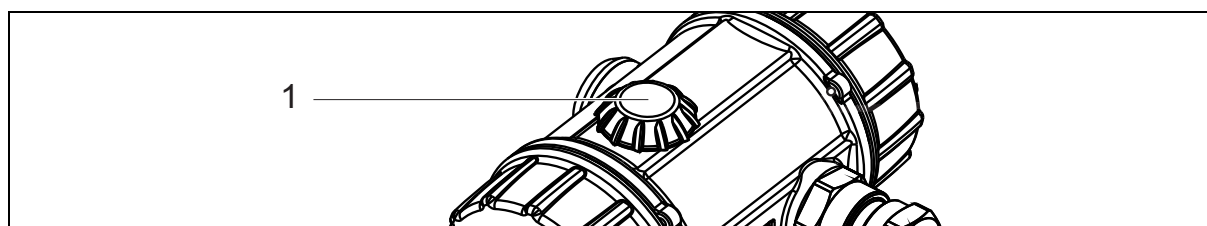

- 1 Rotary knob

The device is operated either

- with the rotary knob (1) or
- via the optional setup program or
- via the HART interface, e.g. with a handheld or PC program.



#### NOTE!

Alternatively, for operation via a rotary knob, all actual values and parameters can very easily be displayed or adjusted by means of the setup program.



Furthermore, the setup program offers an array of useful additional functions, e.g.:

- Recording the measured values
- Graphical view of temperature and pressure
- Detailed diagnostic messages
- Display of the complete order code and the device configuration (can be printed out, e.g. for project documents or follow-up orders)

The setup program can address the device via the following interfaces:

- JUMO setup interface  
The PC interface cable with USB/TTL converter (USB transmitter cable) is required to connect the PC to the device, part no. 00456352
- HART interface  
A HART modem is required to connect the PC to the device, part no. 00443447

### Rotating and pressing

|                                                                                    |                                                 |
|------------------------------------------------------------------------------------|-------------------------------------------------|
|   | <b>Rotate</b><br>Select parameter or set values |
|  | <b>Press</b><br>Confirm parameter or values     |

## 7 Operation

### 7.3 The level concept


#### Two levels

Operation is on two levels:



#### NOTE!



After the device is turned on, it is on the display level. You can go to the parameter level through the following operation.

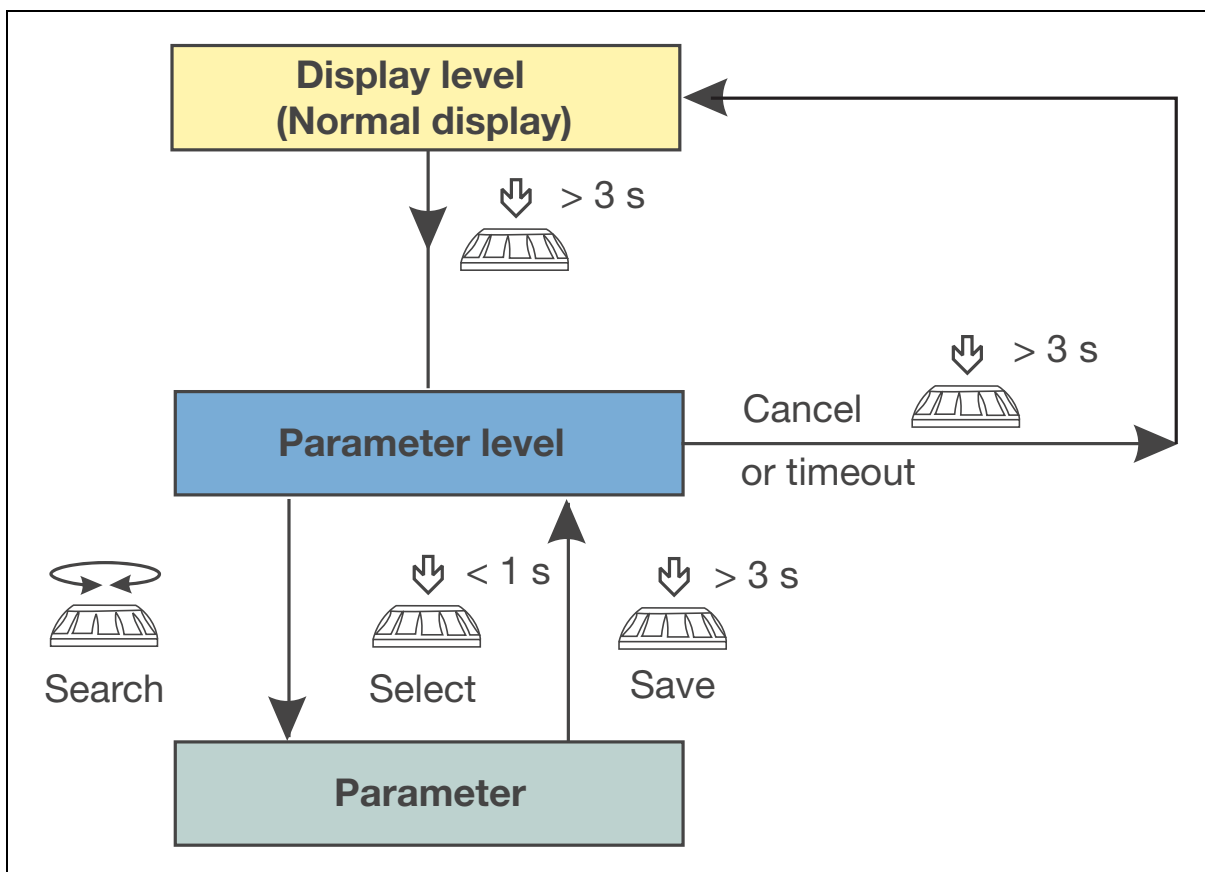

## 7.3.1 The display level

The measured pressure and other values are displayed at the display level. The output current is shown in % as a bar chart in the third line of the display.





It is not possible to change parameters at the display level!

| Action                                                                            | Display (example)                                                                   | Explanation                                                                                     |
|-----------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------|
|  |    | Displays the pressure with measuring unit                                                       |
|                                                                                   |    | Displays the measured value in %<br>or<br>measured value scaled with a choice of measuring unit |
|                                                                                   |    | Displays the calculated output current in mA.                                                   |
|                                                                                   |   | Displays the sensor temperature in °C or °F.                                                    |
|                                                                                   |  | Displays the stored minimum pressure in the selected measuring unit                             |
|                                                                                   |  | Displays the stored maximum pressure                                                            |
|                                                                                   |  | Displays the pressure value and the sensor temperature in the selected measuring units          |




## 7 Operation

### 7.3.2 The parameter level



The device parameters can be displayed and changed at the parameter level.

| Action                                                                            | Display (example)                                                                   | Explanation                                                           | Selection <sup>a</sup>                                                                                          |
|-----------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|-----------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------|
|  |    | <b>P min</b><br>Stored minimum pressure                               | Reset by<br>↓ > 3 seconds<br> |
|                                                                                   |    | <b>P max</b><br>Stored maximum pressure                               | Reset by<br>↓ > 3 seconds<br> |
|                                                                                   |    | <b>P0 Den</b><br>"Density"<br>Density correction                      | 0.01 to <b>1.00</b> to 99.99                                                                                    |
|                                                                                   |    | <b>P1 Uni</b><br>"Unit"<br>Pressure measuring unit                    | inH2O<br>inHG<br>ftH2O<br>mmH2O<br>mmHG<br>PSI<br><b>bar</b><br>mbar<br>kg/cm2<br>kPa<br>TORR<br>MPa<br>mH2O    |
|                                                                                   |  | <b>P2 mA</b><br>Measuring range<br>Lower range value                  | <b>4.00</b> to 20.00 mA                                                                                         |
|                                                                                   |  | <b>P3 mA</b><br>Measuring range<br>Upper range value                  | 4.00 to <b>20.00</b> mA                                                                                         |
|                                                                                   |  | <b>P4 sec</b><br>Attenuation                                          | <b>0.00</b> to 100.0 s                                                                                          |
|                                                                                   |  | <b>P5 RS</b><br>"Range start"<br>Measuring range<br>Lower range value | Nominal measuring range                                                                                         |

## 7 Operation


| Action                                                                            | Display (example)                                                                   | Explanation                                                         | Selection <sup>a</sup>                                                                                                                                                |
|-----------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|---------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  |    | <b>P6 RE</b><br>"Range end"<br>Measuring range<br>Upper range value | Nominal measuring range                                                                                                                                               |
|                                                                                   |    | <b>P7 Zero</b><br>Zero point adjustment                             | Current pressure                                                                                                                                                      |
|                                                                                   |    | <b>P8 mA</b><br>Current generator                                   | 3.60 to <b>4.00</b> to 21.60 mA                                                                                                                                       |
|                                                                                   |    | <b>P9 Err</b><br>Current in case of malfunction                     | ErLo = 3.6 mA<br><b>ErHi = 21.6 mA</b><br>LAsT = last value                                                                                                           |
|                                                                                   |    | <b>P10 Key</b><br>Key lock                                          | <b>0</b> = no lock<br>LA = all, interface released<br>L0 = all, without measurement start<br>LS = alle, ohne Messanfang und -ende<br>LALL = alle, inkl. Schnittstelle |
|                                                                                   |  | <b>P11 Chr</b><br>Characteristic line<br>"Characteristic"           | <b>Lin = linear</b><br>SLin = linear bis Beginn Radizierung<br>SoFF = off until start of square root extraction                                                       |
|                                                                                   |  | <b>P12 %</b><br>Insertion point of Radizierung                      | 5.0 to <b>9.4</b> to 15.0 %<br>vom Ausgangsstrom                                                                                                                      |
|                                                                                   |  | <b>P13 SWV</b><br>Software version                                  | Editing not possible                                                                                                                                                  |
|                                                                                   |  | <b>P14 Uni</b><br>Temperature measuring unit                        | °C/°F                                                                                                                                                                 |
|                                                                                   |  | <b>P15 OFF</b><br>Pressure value offset<br>(zero offset)            | Nominal measuring range                                                                                                                                               |

## 7 Operation

| Action                                                                            | Display (example)                                                                   | Explanation                                                        | Selection <sup>a</sup>                                                                                                                            |
|-----------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|--------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------|
|  |    | <b>P16 SCS</b><br>Scaling start<br>„Scaling start“                 | -9999 to <b>0</b> to +9999                                                                                                                        |
|                                                                                   |    | <b>P17 SCE</b><br>Scaling end<br>„Scaling end“                     | -9999 to <b>100</b> to +9999                                                                                                                      |
|                                                                                   |    | <b>P18 SCD</b><br>Decimal place scaling<br>„Scaling decimal point“ | <b>Auto = automatic</b><br>0 = no decimal place<br>1 = 1 decimal place<br>2 = 2 decimal places<br>3 = 3 decimal places                            |
|                                                                                   |    | <b>P19 %</b><br>Scaling unit                                       | <b>% (default setting)</b><br>kg/sec<br>kg/min<br>kg/h<br>t/min<br>t/h<br>l/sec<br>l/min<br>l/h<br>m3/sec<br>m3/min<br>m3/h<br>L<br>m3<br>UsrTEXT |
|                                                                                   |  | <b>P20 h</b><br>Operating hours                                    | Editing not possible                                                                                                                              |

<sup>a</sup> Default settings are shown in **bold**.

## 8.1 Data flow diagram

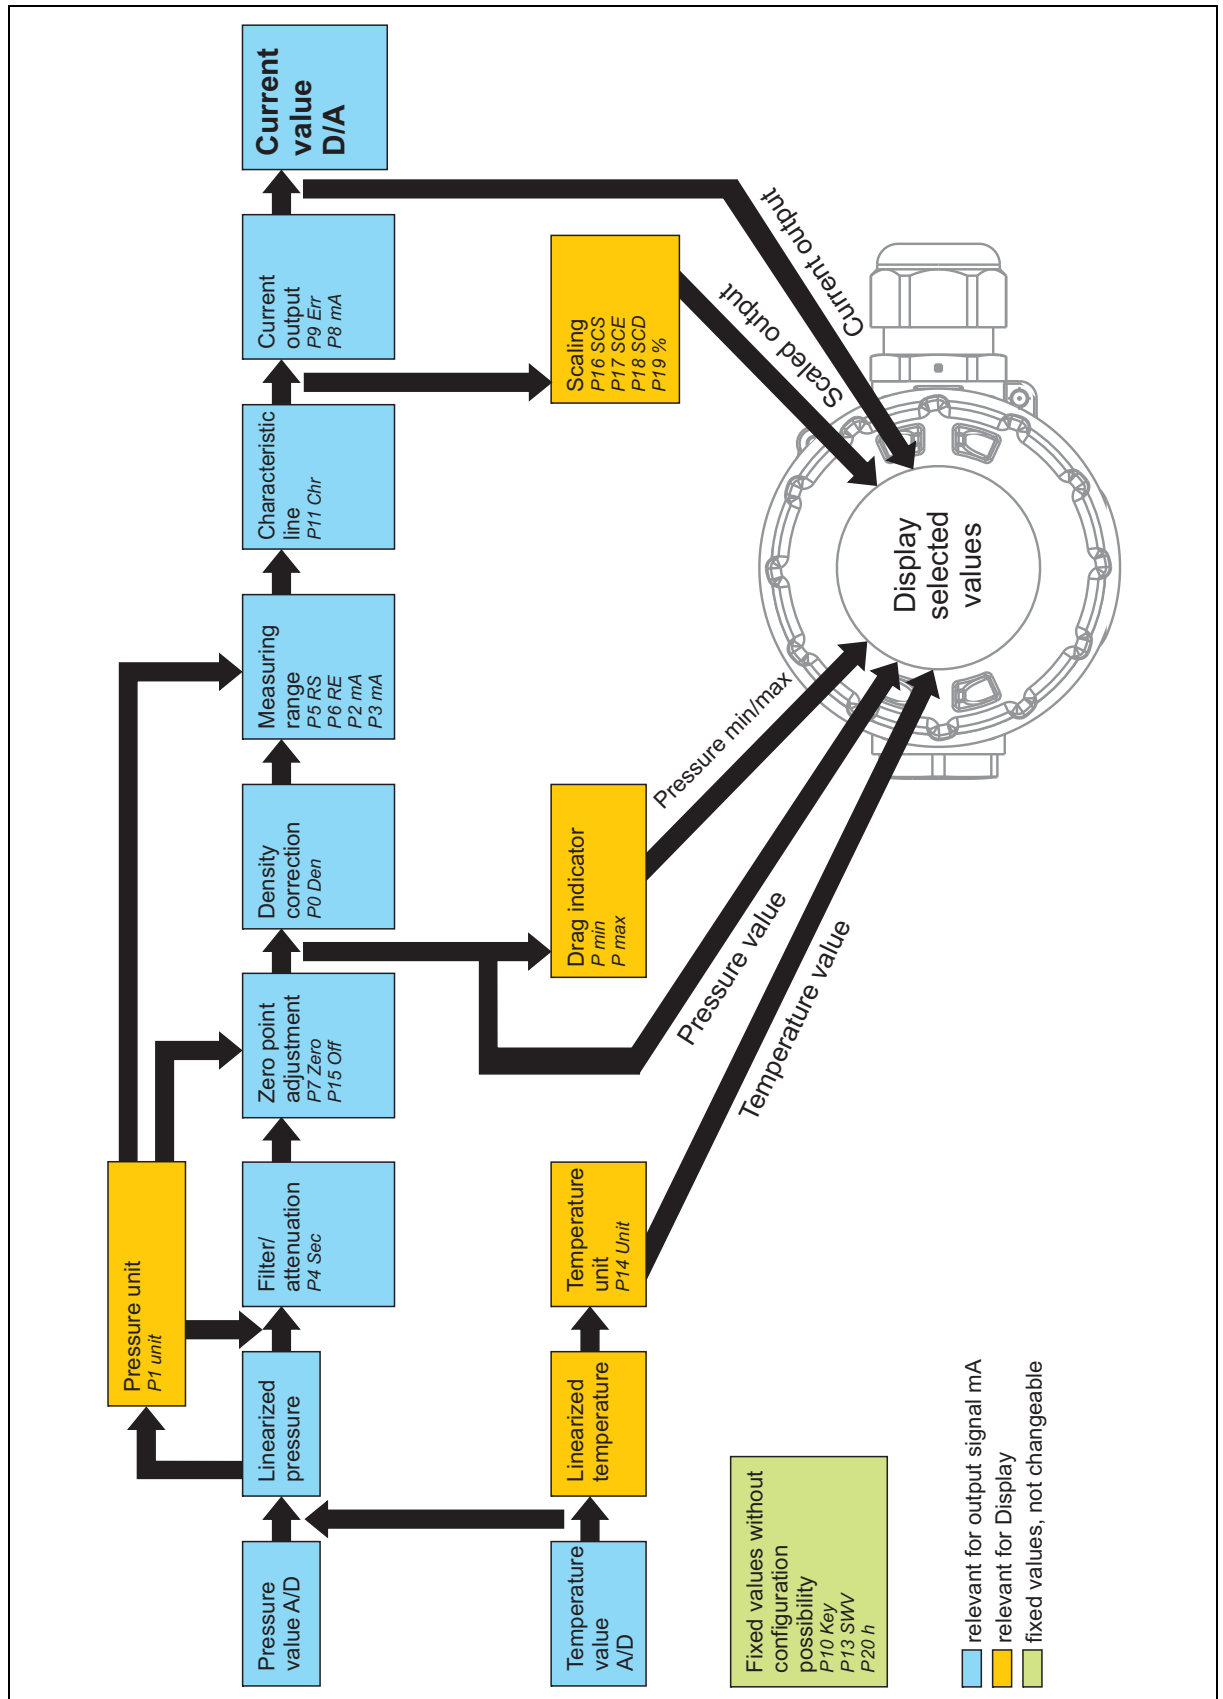

# 8 Configuration

---

## 8.2 Description of the possible configurations

### P0 Den Density correction

Configuration of the density of the medium to be measured

This may, for example, be relevant for the level measurement in order to display the correct filling height from the measured pressure.



#### CAUTION!

**The set value should remain at the value 1 and should be changed in exceptional cases.**

---

### P1 Uni Pressure measuring unit

The pressure value unit can be configured here. The pressure value unit is shown on the display and can be taken from the HART protocol.

### P2 mA Measuring range lower range value

Configuration of the device (measuring range) with pressure specification

If the tank is empty, the start point (zero point) of the pressure/level measurement can be set here. The advantage of this procedure: The device is immediately configured for the application (e.g. tank).



#### CAUTION!

**No further density corrections may be configured. No other values may be entered under P5 RS.**

---

### P3 mA Measuring range upper range value

Configuration of the device (measuring range) with pressure specification

If the tank is full, the end point (full) of the pressure/level measurement can be set here. The advantage of this procedure: The device is immediately configured for the application (e.g. tank).



#### CAUTION!

**No further density corrections may be configured. No other values may be entered under P6 RE.**

---

### P4 Sec Attenuation

Time constant defined in seconds

Depending on the default setting, it is ensured that the measured value responds with a delay to short, fast pressure changes.

### P5 RS Measuring range lower range value

Configuration of the device (measuring range) without pressure specification

Any values can be entered here as the lower range value. It is important when, for example, a differential pressure measurement with a diaphragm seal is attached to an application (e.g. filling level) and no configuration with a pressure specification can be performed.

There is a calculation example available under chapter 8.4 "Level measurement configuration without a pressure specification with or without a diaphragm seal", Page 57.



#### CAUTION!

**No further density corrections may be configured. No other values may be entered under P2 mA.**

---

### P6 RE Measuring range upper range value

Configuration of the device (measuring range) without pressure specification

Any values can be entered here as the upper range value. It is important when, for example, a differential pressure measurement with a diaphragm seal is attached to an application (e.g. filling level) and no configuration with a pressure specification can be performed. There is a calculation example available under chapter 8.4 "Level measurement configuration without a pressure specification with or without a diaphragm seal", Page 57.



### CAUTION!

**No further density corrections may be configured. No other values may be entered under P3 mA.**

**P7 Zero**      **Zero point adjustment** (only for relative pressure)

The applied pressure is stored as a zero point.



### CAUTION!

**Only perform this configuration if it is certain that the zero point is actually present on the device (e.g. after installing or correcting the position of the device). Otherwise a zero offset can also be configured with this. The zero offset is stored as an offset (P15).**

**Zero point adjustment is not possible with absolute pressure sensors.**

**P8 mA**      **Current generator**

The device outputs a freely adjustable current value. The analog output has no reference to the pressure measurement. The actual pressure measurement continues to be performed in the background and can be queried via the interfaces. If the current generator was manually started via P8, this is represented by an icon next to P8 and can also be stopped again by exiting P8.

**P9 Err**      **Current in case of malfunction**

Option for setting which fault current the device should output in case of a malfunction. The default value is set to 21.6 mA according to NAMUR NE 43.

**P10 Key**      **Key lock**

This makes it possible to set a keypad lock in different stages. This is a safety feature to prevent accidental, but also intentional configuration changes to the device.



### NOTE!

To cancel a set lock (LA, L0, LS), the user must press the P-key for longer than 5 s in the "Current in case of malfunction" (P9 Err) display screen.


The "LALL" lock can only be set or canceled in the setup program.

## 8 Configuration

### P11 Chr Characteristic line

This point is not relevant for relative/absolute pressure measurement and should therefore not be configured. It can be used with the differential pressure measurement to implement a flow measurement.

With P11, the characteristic line of the preset value  $Lin = \text{pressure proportional}$  can be re-configured to a square root extraction characteristic line  $SLin$  or  $SOFF = \text{flow proportional}$ . For the flow measurement, parameter P12 = insertion point relevant, below the characteristic line for low flow suppression either linearly connected ( $SLin$ ) or completely disabled ( $SOFF$ ).

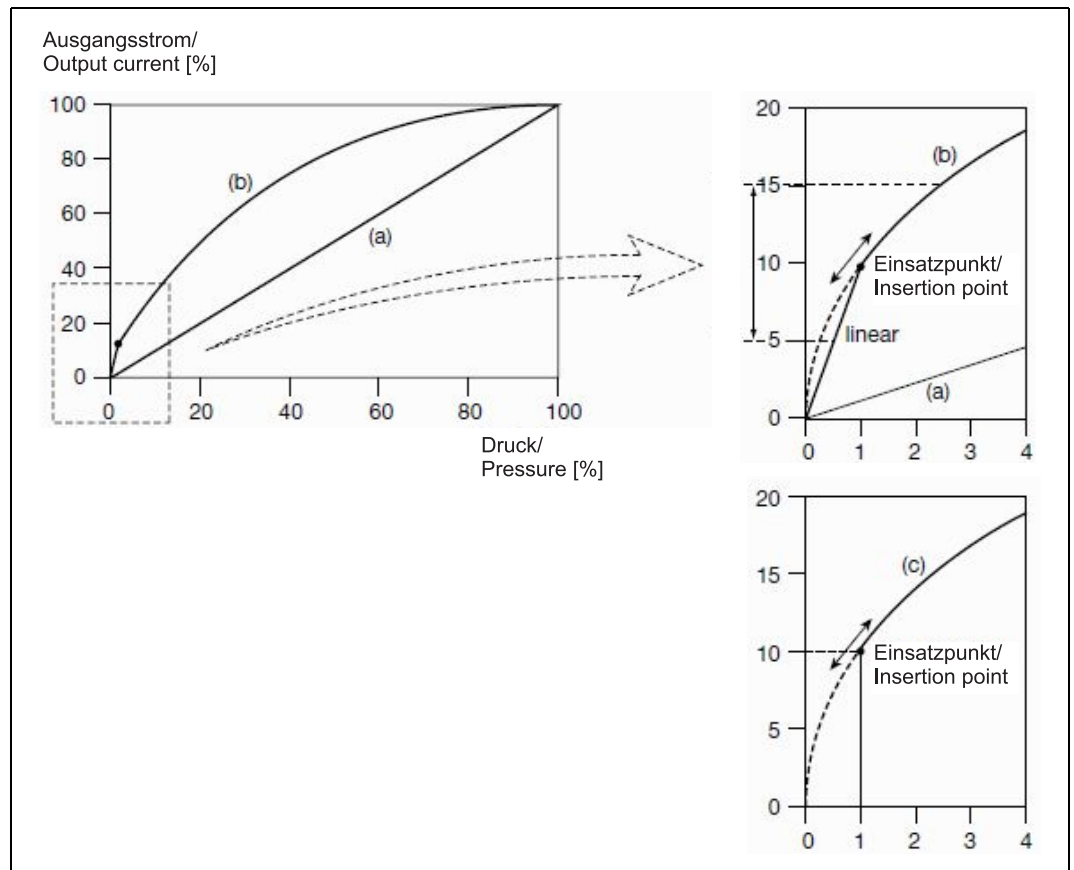

(a) = Lin = linear

(b) = SLin = square-root, linear up to insertion point

(c) = SOFF = square-root, disconnected up to insertion point

### P12 % Insertion point of the square root extraction

This point is not relevant for relative/absolute pressure measurement and should therefore not be configured. It can be used with the differential pressure measurement to implement a flow measurement. The insertion point of the square root extraction sets the start point for the flow measurement.

### P13 SWV Software version

For information only  
No configuration option

### P14 Uni Temperature measuring unit

The temperature value can be read on the display or via the HART signal. There is no option to transmit the temperature value via a 4 to 20 mA signal. The temperature unit can be configured here.

|                |                                                                                                                                                                                                                                                                                                                                                 |
|----------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>P15 Off</b> | <b>Pressure value offset</b><br>The offset value of the pressure value (relative or absolute pressure) is shown in figures here (e.g. after the zero point adjustment). The values listed there should only be corrected in exceptional cases as it is possible to manually readjust an offset there. Please contact the manufacturer for this. |
| <b>P16 SCS</b> | <b>Scaling start</b><br>Configuration option to show the pressure value assignment on other physical values/units. For example, the pressure value applied on the device can be scaled to liters and other units (see P19). The scaling start is set here (e.g. 0).                                                                             |
| <b>P17 SCE</b> | <b>Scaling end</b><br>Configuration option to show the pressure value assignment on other physical values/units. For example, the pressure value applied on the device can be scaled to liters and other units (see P19). The scaling end is set here (e.g. 100).                                                                               |
| <b>P18 SCD</b> | <b>Decimal place scaling</b><br>Configuration option to show the pressure value assignment on other physical values/units. For example, the pressure value applied on the device can be scaled to liters and other units (see P19). The scaling decimal place is set here.                                                                      |
| <b>P19 %</b>   | <b>Scaling unit</b><br>Configuration option to show the pressure value assignment on other physical values/units. The scaling unit is set here.                                                                                                                                                                                                 |
| <b>P20 h</b>   | <b>Operating hours</b><br>For information only<br>No configuration option                                                                                                                                                                                                                                                                       |

## 8 Configuration

### 8.3 Level measurement configuration with a pressure specification - recommended (tank empty, tank full)

The following description applies to level measurements of all measuring ranges with or without a diaphragm seal.

#### With rotary knob operation (parameter level)

**Swap from display level to parameter level**, see chapter 7.3 "The level concept", Page 46


The following configuration steps should be taken:

- P1 Measuring unit, e.g. mbar
- P2 Measuring range lower range value: 4 mA (configuration with empty tank)
- P3 Measuring range upper range value: 20 mA (configuration with full tank)
- P4 Attenuation: 0
- P14 Temperature measuring unit (only for displaying or as HART signal): °C
- P16 Scaling start: scaling on the tank, e.g. in liters: 0
- P17 Scaling end: scaling on the tank, e.g. in liters: 200
- P19 Scaling unit: L (liters)

**Swap from parameter level to display level**

#### With JUMO setup program

**Extras**      **Extras: Online operation\_measuring start with pressure transmitter (zero)** – with empty tank  
Confirm transfer.

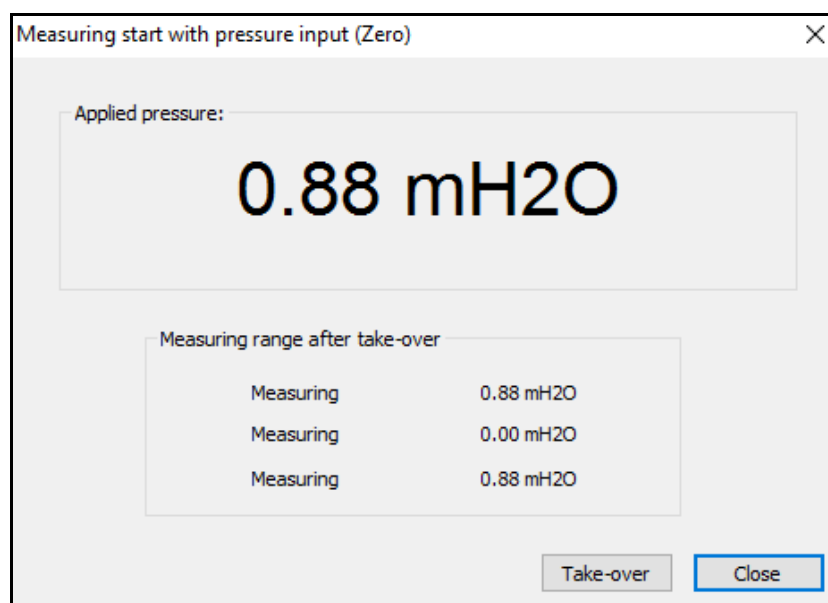


**Extras**      **Extras: Online operation\_measuring end with pressure transmitter (span)** – with full tank  
Confirm transfer.



#### NOTE!

No zero point adjustment should be performed when configuring the level measurement with a pressure specification.

### 8.4 Level measurement configuration without a pressure specification with or without a diaphragm seal

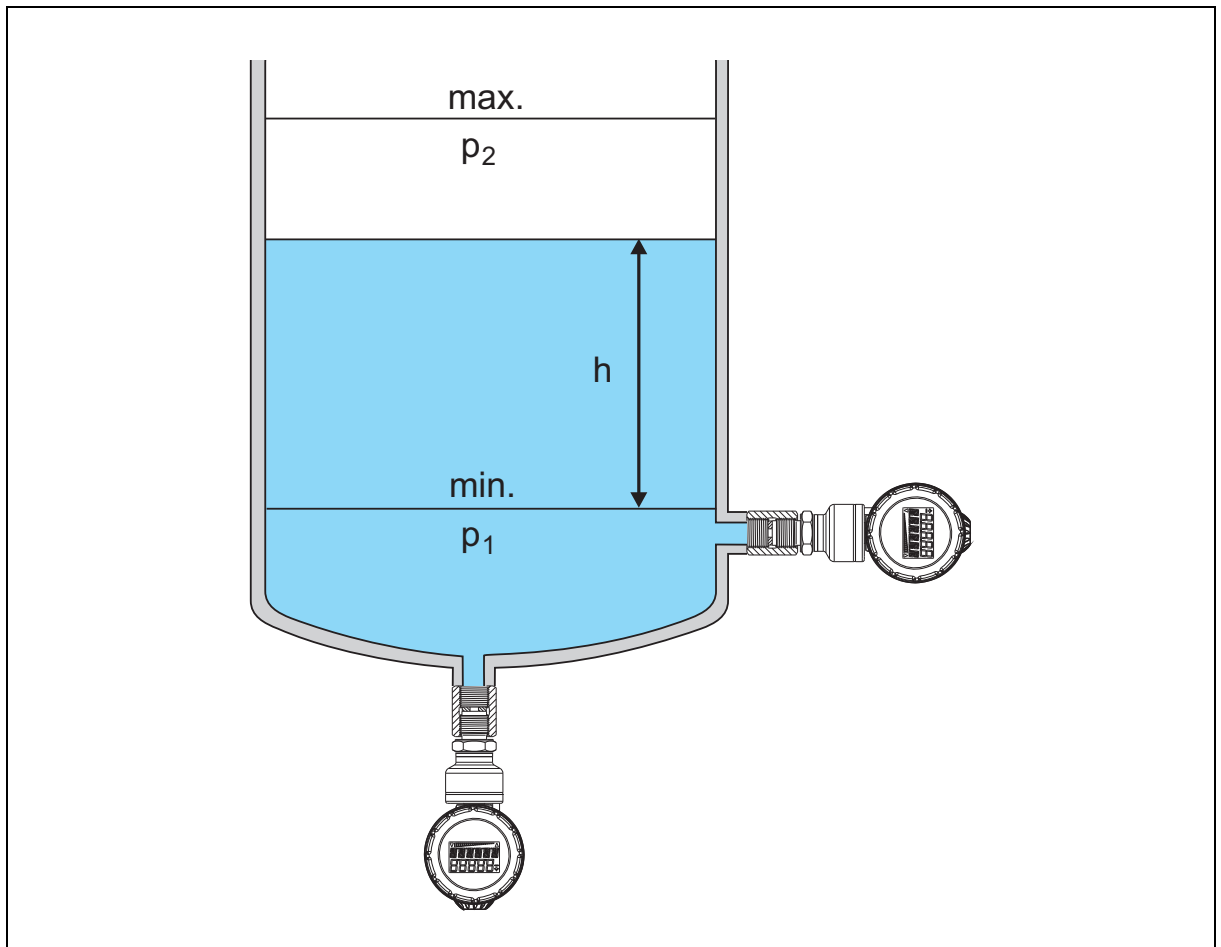

h (filling level)      4 to 20 mA

#### With rotary knob operation (parameter level)

**Swap from display level to parameter level**, see chapter 7.3 "The level concept", Page 46

The following configuration steps should be taken:

- |     |                                                                            |
|-----|----------------------------------------------------------------------------|
| P1  | Unit, e. g. mbar                                                           |
| P4  | Attenuation: 0                                                             |
| P5  | Measuring range lower range value: 0                                       |
| P6  | Measuring range upper range value: 2.00 (2 m water column in this example) |
| P7  | Zero point adjustment, set device to zero, e.g. if tank is empty           |
| P14 | Temperature measuring unit (only for displaying or as HART® signal): °C    |
| P16 | Scaling start: scaling on the tank, e.g. in liters: 0                      |
| P17 | Scaling end: scaling on the tank, e.g. in liters: 200                      |
| P19 | Scaling unit: L (liters)                                                   |

**Swap from parameter level to display level**

## 8 Configuration

With JUMO setup program

**Data transfer from the device**

Editing      Maintenance

The following dialog window opens:

Maintenance

Range

Measurement unit (P01): mH2O

Measuring start (P05): -0.004 mH2O

Measuring end (P06): 0.883 mH2O

Offset (P15): -0.210 mH2O

Characteristic

Damping (P04): 2.5 sec

Characteristic: Linear

Start of: 9.4 %

Scaling

Start (P16): 0.00

End (P17): 8.00

max. no. of decimal places (P18): Automatic

Unit (P19): l

Customized:

Date

Measuring point date: 01.01.2008 Today

OK Cancel

- P01      Measuring unit, e.g. mbar
- P04      Attenuation: 0
- P05      Measuring range lower range value: 0
- P06      Measuring range upper range value: 2.00 (2 m water column in this example)
- P11      Characteristic line: linear
- P14      Temperature measuring unit (only for displaying or as HART signal): °C
- P16      Scaling start: scaling on the tank, e.g. in liters: 0
- P17      Scaling end: scaling on the tank, e.g. in liters: 200
- P18      Maximum decimal place: automatic
- P19      Scaling unit: L (liters)

After entering the desired values: Data transfer to device

**Zero point adjustment, set device to zero, e.g. if tank is empty**




**Extras      Extras: Online operation\_sensor zero point calibration**



## NOTE!

If you notice an external fault (including a mechanical one), the device must be sent to the manufacturer to be repaired.

## 9.1 Overcoming errors and malfunctions

| Error/fault                       |                                                                                     | Possible cause                                                   | Remedy                                                                                                               |
|-----------------------------------|-------------------------------------------------------------------------------------|------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------|
| Display:                          | None                                                                                | No voltage supply                                                | Turn on the voltage supply                                                                                           |
|                                   |                                                                                     | Device faulty                                                    | Send the device to the supplier for repairs.                                                                         |
| Display:                          |    | Overrange, overpressure                                          | Bring the pressure back into the measuring range or adjust the measuring range.                                      |
| Display:                          |    | Underrange, underpressure                                        |                                                                                                                      |
| Display:                          |   | Pressure can no longer be displayed, overpressure                | Adjust scaling or unit of measure                                                                                    |
| Display:                          |  | Pressure can no longer be displayed, underpressure               |                                                                                                                      |
| Display:                          |  | The connection between sensor and electronic is broken.          | a) Proof the plug connection at the back of the electronic module<br>b) Send the device to the supplier for repairs. |
| Display:                          |  | An error was discovered in the electronics during the self test. | Send the device to the supplier for repairs.                                                                         |
| Display:                          |  | Temperature sensor or pressure sensor faulty                     | Send the device to the supplier for repairs.                                                                         |
| The rotary knob is not responding |  | Keyboard lock                                                    | Override keyboard lock                                                                                               |
|                                   |                                                                                     | Device faulty                                                    | Send the device to the supplier for repairs.                                                                         |

# 10 HART 7 specification

The device is in the version with HART protocol if it has a corresponding identification marking on the nameplate: 4 to 20 mA HART.

## 10.1 Device identification

|                            |                                         |
|----------------------------|-----------------------------------------|
| Manufacturer               | JUMO GmbH & Co. KG                      |
| Manufacturer ID            | 24716 (0x608C)                          |
| Device type                | JUMO dTRANS p20                         |
| Device ID                  | 58062 (0xE2CE)                          |
| HART Protocol Version      | 7                                       |
| Device version             | 1                                       |
| Number of device variables | 3                                       |
| Physical layers supported  | FSK                                     |
| Device category            | Transmitter, without galvanic isolation |

## 10.2 Variable codes

The process pressure transmitter supports three device variables and two dynamic device variables as well as the fixed measurands percentage value and milliampere value.

The following table describes the variable numbering that is required for commands 9, 54, and 107.

| Variable code | Designation            | Class                                                                               | Unit                                                                                                                                  |
|---------------|------------------------|-------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------|
| 0             | Customer scaled value  | Depending on the current P19 unit:<br>0 = not classified<br>66 = flow<br>68 = level | Depending on the current P19 unit:<br>57, 73, 74, 75, 77, 78, 24, 17, 138, 28, 131, 19, 41, 43, 253<br>= diverse flow and level units |
| 1             | Drag indicator minimum | 65 = pressure                                                                       | Depending on the current P1 unit:<br>1, 2, 3, 4, 5, 6, 7, 8, 10, 12, 13, 237, 240<br>= diverse pressure units                         |
| 2             | Drag indicator maximum | 65 = pressure                                                                       | Depending on the current P1 unit:<br>1, 2, 3, 4, 5, 6, 7, 8, 10, 12, 13, 237, 240<br>= diverse pressure units                         |
| 244           | Percent                | 0 = not classified                                                                  | 57 = percent                                                                                                                          |
| 245           | Current                | 84 = current                                                                        | 39 = mA                                                                                                                               |
| 246           | Primary variable       | 65 = pressure                                                                       | Depending on the current P1 unit:<br>1, 2, 3, 4, 5, 6, 7, 8, 10, 12, 13, 237, 240<br>= diverse pressure units                         |
| 247           | Secondary variable     | 64 = temperature                                                                    | Depending on the current P14 unit:<br>32 = level C<br>33 = level F                                                                    |

## 10.3 HART commands

| Command                                                  | Designation                           | Request data                                                                           | Response data<br>(plus 2 status bytes7)                                                                                                                                 |
|----------------------------------------------------------|---------------------------------------|----------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Universal commands (0 to 30 as well as 38 and 48)</b> |                                       |                                                                                        |                                                                                                                                                                         |
| 0                                                        | Read unique identifier                | None                                                                                   | 22 bytes<br>includes the long address                                                                                                                                   |
| 1                                                        | Read Primary Variable                 | None                                                                                   | 1 byte unit code P<br>4 bytes pressure P as float                                                                                                                       |
| 2                                                        | Read current and percent              | None                                                                                   | 4 bytes current as float<br>4 bytes percent as float                                                                                                                    |
| 3                                                        | Read current and dynamic variables    | None                                                                                   | 4 bytes current as float<br>1 byte unit code P<br>4 bytes pressure P as float<br>1 byte unit code T<br>4 bytes temp T as float                                          |
| 6                                                        | Write polling address                 | 1 byte short address<br>1 byte LoopCurr_active                                         | As request                                                                                                                                                              |
| 7                                                        | Read loop configuration               | None                                                                                   | 1 byte short address<br>1 byte LoopCurr_active                                                                                                                          |
| 8                                                        | Read dynamic variable classifications | None                                                                                   | 1 Byte Class PrimV<br>1 Byte Class SecV<br>1 Byte Class ThirdV<br>1 Byte Class QuadV                                                                                    |
| 9                                                        | Read device variables with status     | 1 byte DevVarCode<br>[1 byte DevVarCode]<br>[1 byte DevVarCode]<br>[1 byte DevVarCode] | 1 byte ExtendedDevStatus<br>8 bytes info about DevVar<br>[8 bytes info about DevVar]<br>[8 bytes info about DevVar]<br>[8 bytes info about DevVar]<br>4 bytes TimeStamp |
| 11                                                       | Read unique identifier by TAG         | 6 bytes TAG no.                                                                        | Same as command 0                                                                                                                                                       |
| 12                                                       | Read message                          | None                                                                                   | 24 bytes message                                                                                                                                                        |
| 13                                                       | Read TAG + descriptor + date          | None                                                                                   | 6 bytes TAG no.<br><br>12 bytes description<br>3 bytes date                                                                                                             |
| 14                                                       | Read PV sensor info                   | None                                                                                   | 3 bytes sensor man.no.<br>1 byte unit code sensor<br>4 bytes SensorMax as float<br>4 bytes SensorMin as float<br>4 bytes SensorSpan as float                            |

## 10 HART 7 specification

| Command                                                       | Designation                                                       | Request data                                                            | Response data<br>(plus 2 status bytes7)                                                                                                                                                                                                |
|---------------------------------------------------------------|-------------------------------------------------------------------|-------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 15                                                            | Read device info                                                  | None                                                                    | 1 byte alarm code<br>1 byte "P11 Chr"<br>1 byte unit code sensor<br>4 bytes "P6 RE" (range end)<br>4 bytes "P5 RS" (range start)<br>4 bytes "P4 sec"<br>1 byte code write lock<br>1 byte manufacturer code<br>1 byte AnalogChannelFlag |
| 16                                                            | Read final assembly number                                        | None                                                                    | 3 bytes assembly number                                                                                                                                                                                                                |
| 17                                                            | Write message                                                     | 24 bytes message                                                        | As request                                                                                                                                                                                                                             |
| 18                                                            | Write TAG + descriptor + date                                     | 6 bytes TAG no.<br><br>12 bytes description<br>3 bytes calibration date | As request                                                                                                                                                                                                                             |
| 19                                                            | Write final assembly number                                       | 3 bytes assembly number                                                 | As request                                                                                                                                                                                                                             |
| 20                                                            | Read long TAG                                                     | None                                                                    | 32 bytes long TAG                                                                                                                                                                                                                      |
| 21                                                            | Read unique identifier by Long TAG                                | 32 bytes long TAG                                                       | Same as command 0                                                                                                                                                                                                                      |
| 22                                                            | Write long TAG                                                    | 32 bytes long TAG                                                       | As request                                                                                                                                                                                                                             |
| <b>Common Practice Commands (32 to 121, except 38 and 48)</b> |                                                                   |                                                                         |                                                                                                                                                                                                                                        |
| 34                                                            | Write damping value                                               | 4 bytes "P4 sec"                                                        | As request                                                                                                                                                                                                                             |
| 35                                                            | Write range values                                                | 1 byte unit code<br>4 bytes "P6 RE"<br>4 bytes "P5 RS"                  | As request                                                                                                                                                                                                                             |
| 36                                                            | Set upper range value                                             | None                                                                    | None                                                                                                                                                                                                                                   |
| 37                                                            | Set lower range value                                             | None                                                                    | None                                                                                                                                                                                                                                   |
| 38                                                            | Reset configuration changed flag                                  | 2 bytes ConfigChCnt                                                     | 2 bytes ConfigChCnt                                                                                                                                                                                                                    |
| 40                                                            | Fixed current mode                                                | 4 bytes "P8 mA"<br>(0 = Current generator mode off)                     | As request                                                                                                                                                                                                                             |
| 41                                                            | Perform self test                                                 | None                                                                    | None                                                                                                                                                                                                                                   |
| 42                                                            | Perform device reset                                              | None                                                                    | None                                                                                                                                                                                                                                   |
| 43                                                            | Set PV zero ("P7 Zero")<br>Absent with absolute pressure sensors! | None                                                                    | None                                                                                                                                                                                                                                   |
| 44                                                            | Write PV units                                                    | 1 byte "P1 Uni"                                                         | As request                                                                                                                                                                                                                             |
| 45                                                            | Trim loop current zero                                            | 4 bytes measured mA as float                                            | As request                                                                                                                                                                                                                             |
| 46                                                            | Trim loop current gain                                            | 4 bytes measured mA as float                                            | As request                                                                                                                                                                                                                             |

## 10 HART 7 specification

| Command | Designation                        | Request data                                                                                                                                                                           | Response data<br>(plus 2 status bytes7)                                                                                                                                                                                                                                                               |
|---------|------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 48      | Read additional device status      | None                                                                                                                                                                                   | 6 bytes dev specific status<br><br>1 byte extended dev status<br>1 byte dev operating mode<br>1 byte standardized status                                                                                                                                                                              |
| 54      | Read device variable info          | 1 byte DevVarCode                                                                                                                                                                      | 27 bytes info about DevVar                                                                                                                                                                                                                                                                            |
| 59      | Write number of response preambles | 1 byte number of preambles                                                                                                                                                             | As request                                                                                                                                                                                                                                                                                            |
| 103     | Write burst period                 | 1 byte BurstMsgNr<br>4 bytes BurstMinUpdTime<br>4 bytes BurstMaxUpdTime                                                                                                                | As approved request; invalid values are automatically set to the nearest valid value                                                                                                                                                                                                                  |
| 104     | Write burst trigger                | 1 byte BurstMsgNr<br>1 byte BurstTrigMode<br>1 byte BurstTrigClass<br>1 byte BurstTrigUnits<br>4 bytes BurstTrigValue                                                                  | As request                                                                                                                                                                                                                                                                                            |
| 105     | Read burst mode configuration      | [1 byte BurstMsgNo]                                                                                                                                                                    | 1 byte BurstAktiv<br><br>1 byte BurstCmd<br>8 bytes BurstDevVarCode<br>1 byte BurstMsgNr<br>1 byte number BurstCfg<br>2 bytes BurstCmd16Bit<br>4 bytes BurstMinUpdTime<br>4 bytes BurstMaxUpdTime<br>1 byte BurstTrigMode<br>1 byte BurstTrigClass<br>1 byte BurstTrigUnits<br>4 bytes BurstTrigValue |
| 107     | Write burst device variables       | 1 byte DevVarCode<br><br>[1 byte DevVarCode]<br>[1 byte DevVarCode]<br>[1 byte DevVarCode]<br>[1 byte DevVarCode]<br>[1 byte DevVarCode]<br>[1 byte DevVarCode]<br>[1 byte BurstMsgNo] | 8 bytes BurstDevVarCode<br><br>1 byte BurstMsgNr                                                                                                                                                                                                                                                      |
| 108     | Write burst mode command number    | 2 bytes BurstCmd16Bit<br>1 byte BurstMsgNr                                                                                                                                             | As request                                                                                                                                                                                                                                                                                            |
| 109     | Burst Mode Control                 | 1 byte Burst_Active<br>[1 byte BurstMsgNo]                                                                                                                                             | As request                                                                                                                                                                                                                                                                                            |

# 10 HART 7 specification

| Command                                      | Designation                    | Request data                               | Response data<br>(plus 2 status bytes7)                             |
|----------------------------------------------|--------------------------------|--------------------------------------------|---------------------------------------------------------------------|
| <b>Device-specific commands (128 to 253)</b> |                                |                                            |                                                                     |
| 128                                          | Write offset                   | 1 byte unit code<br>4 bytes "P15 OFF"      | As request                                                          |
| 129                                          | Read offset                    | None                                       | 1 byte "P1 Uni"<br>4 bytes "P15 OFF"                                |
| 130                                          | Reset min/max value            | 1 byte both/min/max                        | As request                                                          |
| 131                                          | Read min/max value             | None                                       | 4 bytes DragIndicatorMax<br>4 bytes DragIndicatorMin<br>In "P1 Uni" |
| 132                                          | Write output mode              | 1 byte "P11 Chr"                           | As request                                                          |
| 133                                          | Read output mode               | None                                       | 1 byte "P11 Chr"                                                    |
| 134                                          | Write error mode               | 1 byte "P9 Err"                            | As request                                                          |
| 135                                          | Read error mode                | None                                       | 1 byte "P9 Err"                                                     |
| 136                                          | Write keyboard mode            | 1 byte "P10 Key"                           | As request                                                          |
| 137                                          | Read keyboard mode             | None                                       | 1 byte "P10 Key"                                                    |
| 138                                          | Write temperature unit         | 1 byte "P14 Uni"                           | As request                                                          |
| 141                                          | Read square root start         | None                                       | 4 bytes "P12 %"                                                     |
| 142                                          | Write square root start        | 4 bytes "P12 %"                            | As request                                                          |
| 147                                          | Write Scale_Beg +<br>Scale_End | 4 bytes "P17 SCE"<br><br>4 bytes "P16 SCS" | As request                                                          |
| 148                                          | Read Scale_Beg +<br>Scale_End  | None                                       | 4 bytes "P17 SCE"<br><br>4 bytes "P16 SCS"                          |
| 149                                          | Write Scale_Unit               | 1 byte unit code for "P19<br>%"            | As request                                                          |
| 151                                          | Write Scale_Comma              | 1 byte "P18 SCD"<br>[Auto/0/1/2/3]         | As request                                                          |
| 152                                          | Read Scale_Comma               | None                                       | 1 byte "P18 SCD"<br>[Auto/0/1/2/3]                                  |

## 10.4 Burst mode commands

The burst mode is an operating mode in which the device sends telegrams independently without an inquiry. It is configured with the setup program or with the commands 103 to 109.

The following commands are available:

| Command | Designation                   |
|---------|-------------------------------|
| 1       | Primary variable              |
| 2       | Current and percent           |
| 3       | Current and dynamic variables |
| 9       | Device variables              |
| 48      | Additional device status      |

## 10.5 Performance data

The parameters that are listed below determine the performance of the process pressure transmitter.

### Telegram length

The maximum telegram length of up to 68 bytes occurs with this HART 7 device with command 9 (39 bytes payload including 2 status bytes).

### Operating modes

The process pressure transmitter has three output operating modes:

- Standard mode (single mode): current proportional to measurand
- Current generator mode: current is adjusted through HART command 40 or through adjustment parameter "P8 mA"
- Constant current mode (multidrop mode): current is set to constant 4 mA in bus operation (HART command 6)

### Write protection

The device can be protected against unintentional overwriting of a parameter through a keyboard lock.

- At the device through parameter "P10 key"
- In the setup program under "Further maintenance data - Inhibit (P10)"
- Via HART command 136 and 137

# 11 Certificates

## JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



MORE THAN SENSORS  
AND AUTOMATION

## EU-Konformitätserklärung

EU declaration of conformity / Déclaration UE de conformité

### Dokument-Nr.

Document No. / Document n°.

CE 603

### Hersteller

Manufacturer / Etabli par

JUMO GmbH & Co. KG

### Anschrift

Address / Adresse

Moritz-Juchheim-Straße 1, 36039 Fulda, Germany

### Produkt

Product / Produit

### Name

Name / Nom

### Typ

Type / Type

### Typenblatt-Nr.

Data sheet no. / N°

Document

d'identification

dTRANS p20

403025

403025

### Produktbeschreibung

Product description / Description du produit

Industrial pressure transmitter.

**Wir erklären in alleiniger Verantwortung, dass das bezeichnete Produkt die Anforderungen der Europäischen Richtlinien erfüllt.**

*We hereby declare in sole responsibility that the designated product fulfills the requirements of the European Directives.*

*Nous déclarons sous notre seule responsabilité que le produit remplit les Directives Européennes.*

Dokument-Nr.  
Document No. / Document n°.

CE 603

EU-Konformitätserklärung

Seite: 1 von 5

## JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



MORE THAN SENSORS  
AND AUTOMATION

### 1. Richtlinie

*Directive / Directive*

**Name** EMC 2014/30/EU

*Name / Nom*

**Konformitätsbewertungsverfahren** Mod. A

*Conformity assessment procedure /*

*Procédure d'évaluation de la conformité*

**Datum der Erstanbringung des CE-Zeichens auf** 2010

**dem Produkt**

*Date of first application of the CE mark to the product /*

*Date de 1ère application du sigle sur le produit*

### Angewendete Normen/Spezifikationen

*Standards/Specifications applied / Normes/Spécifications appliquées*

#### Referenz

*Reference / Référence*

#### Ausgabe

*Edition / Édition*

#### Bemerkung

*Comment / Remarque*

EN 61326-1

2013

EN 61326-2-3

2013

EN 61326-1

2021

EN 61326-2-3

2021

### Gültig für Typ

*Valid for Type / Valable pour le type*

403025/...

### 2. Richtlinie

*Directive / Directive*

**Name** ATEX 2014/34/EU

*Name / Nom*

**Konformitätsbewertungsverfahren** Mod. B+D

*Conformity assessment procedure /*

*Procédure d'évaluation de la conformité*

**Datum der Erstanbringung des CE-Zeichens auf** 2011

**dem Produkt**

*Date of first application of the CE mark to the product /*

*Date de 1ère application du sigle sur le produit*

Dokument-Nr.

Document No. / Document n°.

CE 603

EU-Konformitätserklärung

Seite: 2 von 5

# 11 Certificates

## JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



MORE THAN SENSORS  
AND AUTOMATION

### Angewendete Normen/Spezifikationen

Standards/Specifications applied / Normes/Spécifications appliquées

#### Referenz

Reference / Référence

#### Ausgabe

Edition / Édition

#### Bemerkung

Comment / Remarque

EN 60079-0

2018

EN 60079-11

2012

EN 60079-26

2015

### Gültig für Typ

Valid for Type / Valable pour le type

403025/\*-1-...

### 2.1 EU-Baumusterprüfbescheinigung

EU type examination certificate / Certificat d'examen de type UE

#### Zertifikatsnummer

Certificate number / Numéro de certificat

SEV 09 ATEX 0138 X

#### Notifizierte Stelle

Notified Body / Organisme notifié

Eurofins Electric & Electronic Product Testing  
AG, Luppenstrasse 3, 8320 Fehraltorf,  
Switzerland

### Qualitätssicherung bezogen auf den Produktionsprozess

Quality assurance of the production process / L'assurance de la qualité de la production

#### Zertifikatsnummer

Certificate number / Numéro de certificat

Available on request

#### Notifizierte Stelle

Notified Body / Organisme notifié

BUREAU VERITAS Consumer Products  
Services Germany GmbH, Wilhelm-Hennemann-  
Straße 8, 19061 Schwerin, Germany

#### Kennnummer

Identification no. / N° d'identification

2004

Dokument-Nr.  
Document No. / Document n°.

CE 603

EU-Konformitätserklärung

Seite: 3 von 5

## JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



**MORE THAN SENSORS  
AND AUTOMATION**

### 3. Richtlinie

*Directive / Directive*

**Name** RoHS 2011/65/EU

*Name / Nom*

**Konformitätsbewertungsverfahren** Mod. A

*Conformity assessment procedure /*

*Procédure d'évaluation de la conformité*

**Datum der Erstanbringung des CE-Zeichens auf** 2017

**dem Produkt**

*Date of first application of the CE mark to the product /*

*Date de 1ère application du sigle sur le produit*

### Angewendete Normen/Spezifikationen

*Standards/Specifications applied / Normes/Spécifications appliquées*

#### Referenz

*Reference / Référence*

#### Ausgabe

*Edition / Édition*

#### Bemerkung

*Comment / Remarque*

VDK Umweltrelevante Aspekte V1

bei der Produktentwicklung und

-gestaltung

### Gültig für Typ

*Valid for Type / Valable pour le type*

403025/...

### 4. Richtlinie

*Directive / Directive*

**Name** PED 2014/68/EU

*Name / Nom*

**Konformitätsbewertungsverfahren** Mod. A

*Conformity assessment procedure /*

*Procédure d'évaluation de la conformité*

**Datum der Erstanbringung des CE-Zeichens auf** 2022

**dem Produkt**

*Date of first application of the CE mark to the product /*

*Date de 1ère application du sigle sur le produit*

Dokument-Nr.

Document No. / Document n°.

CE 603

EU-Konformitätserklärung

Seite: 4 von 5

# 11 Certificates

## JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



**MORE THAN SENSORS  
AND AUTOMATION**

### Angewendete Normen/Spezifikationen

*Standards/Specifications applied / Normes/Spécifications appliquées*

#### Referenz

*Reference / Référence*

AD 2000

#### Ausgabe

*Edition / Édition*

Regulatory Framework

#### Bemerkung

*Comment / Remarque*

### Gültig für Typ

*Valid for Type / Valable pour le type*

Only for types with nominal pressures greater than 200 bar.

### Aussteller

*Issued by / Etabli par*

### Ort, Datum

*Place, date / Lieu, date*

### Rechtsverbindliche Unterschriften

*Legally binding signatures /*

*Signatures juridiquement valable*

JUMO GmbH & Co. KG

Fulda, 2025-11-24

Bereichsleiter Globales Produkt- und  
Branchenmanagement, Marketing  
ppa. Michael Diegelmann

*ppa. Michael Diegelmann*

Bereichsleiter Globale Entwicklung  
ppa. Harald Schöppner

*ppa. Harald Schöppner*

Dokument-Nr.  
Document No. / Document n°.

CE 603


EU-Konformitätserklärung

Seite: 5 von 5



## EU-Type Examination Certificate

- (1)
- (2) Equipment or protective system intended for use in potentially explosive atmospheres - **Directive 2014/34/EU**
- (3) Certificate number: **SEV 09 ATEX 0138 X**
- (4) Product: Process pressure transmitter dTRANS p20 Type 403025, JUMO dTRANS p20 DELTA Type 403022
- (5) Manufacturer: JUMO GmbH & Co. KG
- (6) Address: Moritz-Juchheim-Strasse 1, 36039 Fulda, Germany
- (7) The equipment and any acceptable variation thereto is specified in the schedule to this certificate and the documents therein referred to.
- (8) Eurofins, notified body No. 1258, in accordance with article 17 of Directive 2014/34/EU of the European parliament and of the council, dated 26 February 2014, certifies that this product has been found to comply with the essential health and safety requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.  
The examination and test results are recorded in confidential report no 22CH-01294.X07
- (9) Compliance with the essential health and safety requirements has been assured by compliance with:  
**EN IEC 60079-0:2018**  
**EN 60079-11:2012**  
**EN 60079-26:2015**  
Except in respect of those requirements listed at item 18 of the schedule.
- (10) If the sign «X» is placed after the certificate number, it indicates that the product is subjected to special conditions for safe use specified in the schedule to this certificate. The sign "U" is placed after the certificate number. It indicates that this certificate must not be mistaken for a certificate intended for an equipment or protective system. This partial certification may be used as a basis for certification of an equipment or protective system.
- (11) This EU type examination certificate relates only to design and construction of the specified product. Further requirements of this directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.
- (12) The marking of the product shall include the following:



**Eurofins Electric & Electronic Product Testing AG**  
**Notified Body ATEX**

Munira Gamma  
Product Certification

*M. Gamma*

www.eurofins.ch

Fehraltorf, 2023-11-09

Issue: 6

Page 1 of 3

T8a\_V01



(13)

## Appendix

(14)

EU-Type Examination Certificate no. SEV 09 ATEX 0138 X

(15) **General product information**

The process pressure transmitter JUMO dTRANS p20 type 403025 or JUMO dTRANS p20 DELTA type 403022 serves for converting a physical measured quantity (pressure) into a standard electrical signal (4 ... 20 mA).

The device is intended for use within potentially explosive atmospheres.

The stainless steel enclosure of the pressure transmitter has the type of protection IP 66 according to EN 60529. The pressure transmitter can be housed in three different types of enclosure.

The process pressure transmitter is attached to tanks or pipes by means of a process connection.

The pressure measuring cell serves for zone separation and is made of stainless steel, Hastelloy®, Monel, tantalum or titanium. This zone separation takes place by means of the diaphragm and subsequent flashback safe gap or the flashback safe gaps can also be integrated directly in the process connection upstream of the pressure measuring cell/pressure sensor.

Classification of installation and use:  
Ingress protection:

fixed installation  
IP66

**Marking:**

For type JUMO dTRANS p20 Type 403025:

Ex II 1/2G Ex ia IIC T6...T3 Ga/Gb  
II 1/2D Ex ia IIIC T105 °C Da/Db

For type JUMO dTRANS p20 DELTA Type 403022:

Ex II 1G Ex ia IIC T4 Ga  
II 1D Ex ia IIIC T200/125 °C Da

**Rating:**

Input and supply circuits:

with type of protection intrinsic safety Ex ia IIC  
Only for connection to certified intrinsically safe circuit.

Maximum values:

|                |          |                                  |
|----------------|----------|----------------------------------|
| U <sub>i</sub> | ≤ 28 V   |                                  |
| I <sub>i</sub> | ≤ 115 mA |                                  |
| P <sub>i</sub> | ≤ 750 mW |                                  |
| C <sub>i</sub> | = 6 nF   | (effective internal capacitance) |
| L <sub>i</sub> | = 105 µH | (effective internal inductance)  |

or

Input and supply circuits:

with type of protection intrinsic safety Ex ia IIIC  
Only for connection to certified intrinsically safe circuit.

Maximum values:

|                |          |                                  |
|----------------|----------|----------------------------------|
| U <sub>i</sub> | ≤ 28 V   |                                  |
| I <sub>i</sub> | ≤ 115 mA |                                  |
| P <sub>i</sub> | ≤ 750 mW |                                  |
| C <sub>i</sub> | = 6 nF   | (effective internal capacitance) |
| L <sub>i</sub> | = 105 µH | (effective internal inductance)  |

(16) **Report number**

22CH-01294.X07



(17) **"Special conditions for safe use" / "Schedule of limitations"**

The intrinsically safe circuit must be limited by overvoltage category I as defined in IEC 60664-1 respectively the circuits must be supplied exclusively from a certified intrinsically safe power source with the protection level "ia".

Process pressure transmitter **JUMO dTRANS p20 type 403025** see table below for the relation between maximum permissible ambient temperature in area of electronic enclosure, measurement substances and temperature classes:

| Class of temperature                                                                 | T6         | T5         | T4         | T3         |
|--------------------------------------------------------------------------------------|------------|------------|------------|------------|
| Maximum permissible ambient temperature in the top of enclosure with electronic (°C) | -50 to +50 | -50 to +65 | -50 to +85 | -50 to +85 |
| highest permissible temperature of substance (°C)                                    | +60        | +70        | +115       | +175       |

Process pressure transmitter **JUMO dTRANS p20 DELTA type 403022** see table below for relation between maximum permissible ambient temperature in area of electronic enclosure, measurement substances and temperature classes:

| Class of temperature                                                                 | T4         |
|--------------------------------------------------------------------------------------|------------|
| Maximum permissible ambient temperature in the top of enclosure with electronic (°C) | -50 to +60 |
| highest permissible temperature of substance (°C)                                    | +100       |

Process pressure transmitter **JUMO dTRANS p20 type 403025** see table below for the relation between maximum permissible ambient temperature in area of electronic enclosure, measurement substances and maximum surface temperature:

| Surface temperature                                                                  | T105 °C    |
|--------------------------------------------------------------------------------------|------------|
| Maximum permissible ambient temperature in the top of enclosure with electronic (°C) | -50 to +60 |
| highest permissible temperature of substance (°C)                                    | +100       |

Process pressure transmitter **JUMO dTRANS p20 DELTA type 403022** see table below for the relation between maximum permissible ambient temperature in area of electronic enclosure, measurement substances and maximum surface temperature:

| Surface temperature                                                                  | T <sub>200</sub> 125 °C |
|--------------------------------------------------------------------------------------|-------------------------|
| Maximum permissible ambient temperature in the top of enclosure with electronic (°C) | -50 to +60              |
| highest permissible temperature of substance (°C)                                    | +100                    |

Between -40 °C to -50 °C the equipment must be permanently in operation and the cover with view window must be protected against to mechanical hit or impact.

(18) **Essential health and safety requirements**

In addition to the essential health and safety requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product, and conformity is demonstrated in the report:

|               |                |
|---------------|----------------|
| <b>Clause</b> | <b>Subject</b> |
| None          |                |

(19) **Drawings and Documents**

See test report "Manufacturer's Documents"

# 11 Certificates

**JUMO GmbH & Co. KG**

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



MORE THAN SENSORS  
AND AUTOMATION

## UK Declaration of Conformity

**Document No.** UK 197  
**Manufacturer** JUMO GmbH & Co. KG  
**Address** Moritz-Juchheim-Straße 1, 36039 Fulda, Germany

|                 |             |                       |
|-----------------|-------------|-----------------------|
| <b>Product</b>  |             |                       |
| <b>Name</b>     | <b>Type</b> | <b>Data sheet no.</b> |
| JUMO dTRANS p20 | 403025      | 403025                |

**Product description**  
Process pressure transmitter.

We hereby declare in sole responsibility that the designated product fulfills the requirements of the statutory instruments.

**1. Statutory instrument**

|                                                                  |                                                            |
|------------------------------------------------------------------|------------------------------------------------------------|
| <b>Name</b>                                                      | Electromagnetic Compatibility Regulations 2016<br>No. 1091 |
| <b>Conformity assessment procedure</b>                           | Mod. A                                                     |
| <b>Date of first application of the UKCA mark to the product</b> | 2023                                                       |

**Standards/Specifications applied**

| Reference    | Edition | Comment |
|--------------|---------|---------|
| EN 61326-1   | 2013    |         |
| EN 61326-2-3 | 2013    |         |
| EN 61326-1   | 2021    |         |
| EN 61326-2-3 | 2021    |         |

**Valid for Type**  
403025/...

## JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



**MORE THAN SENSORS  
AND AUTOMATION**

### 2. Statutory instrument

**Name** The Restriction of the Use of Certain Hazardous Substances in Electrical and Electronic Equipment Regulations 2012 No. 3032

**Conformity assessment procedure** Mod. A

**Date of first application of the UKCA mark to the product** 2023

### Standards/Specifications applied

| Reference                                                                   | Edition | Comment |
|-----------------------------------------------------------------------------|---------|---------|
| [VDK] Umweltrelevante Aspekte V1 bei der Produktentwicklung und -gestaltung |         |         |

### Valid for Type

403025/...

### 3. Statutory instrument

**Name** The Equipment and Protective Systems Intended for Use in Potentially Explosive Atmospheres Regulations 2016 No. 1107

**Conformity assessment procedure** Mod. B+D

**Date of first application of the UKCA mark to the product** 2023

### Valid for Type

403025/\*-1-...

### 3.1 Type examination certificate

**Certificate number** EPS 22 UKEX 1 369 X Revision 1

**Designated body** Bureau Veritas Consumer Products Services United Kingdom Limited, 31 Kingsland Grange, Woolston, Warrington, Cheshire, WA1 4RW

Document No.

UK 197

UK Declaration of Conformity

Seite: 2 von 3

# 11 Certificates

**JUMO GmbH & Co. KG**

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



MORE THAN SENSORS  
AND AUTOMATION

**Standards/Specifications applied**

| Reference   | Edition | Comment |
|-------------|---------|---------|
| EN 60079-0  | 2018    |         |
| EN 60079-11 | 2012    |         |
| EN 60079-26 | 2015    |         |

**Quality assurance of the production process**

|                    |                                                                                                                                      |
|--------------------|--------------------------------------------------------------------------------------------------------------------------------------|
| Certificate number | Available on request.                                                                                                                |
| Designated body    | Bureau Veritas Consumer Products Services<br>United Kingdom Limited, 31 Kingsland Grange,<br>Woolston, Warrington, Cheshire, WA1 4RW |
| Identification no. | 8507                                                                                                                                 |

|                            |                                                                                         |
|----------------------------|-----------------------------------------------------------------------------------------|
| Issued by                  | JUMO GmbH & Co. KG                                                                      |
| Place, date                | Fulda, 2025-12-01                                                                       |
| Legally binding signatures | Head of Global Product and Industry<br>Management, Marketing<br>ppa. Michael Diegelmann |

*ppa. Michael Diegelmann*

Head of Global Development  
ppa. Harald Schöppner

*ppa. Harald Schöppner*



## UK - Type Examination Certificate

- (1)
- (2) Equipment and protective systems intended for use in potentially explosive atmospheres – UKSI 2016:1107 (as amended)
- (3) UK - Type Examination Certificate Number  
**EPS 22 UKEX 1 369 X** Revision 1
- (4) Equipment: Process pressure transmitter  
JUMO dTrans p20 type 403025 or  
JUMO dTrans p20 DELTA type 403022
- (5) Manufacturer: JUMO GmbH & Co. KG
- (6) Address: Moritz-Juchheim-Strasse 1  
36039 Fulda  
Germany
- (7) This equipment and any acceptable variation thereto are specified in the annex to this certificate and the documentation therein referred to.
- (8) Bureau Veritas Consumer Products Services United Kingdom Limited, approved body No. 8507 in accordance with UKSI 2016:1107 (as amended) Part 4, certifies that this equipment has been found to comply with the essential health and safety requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmospheres, given in Schedule 1 of UKSI 2016:1107 (as amended). The examination and test results are recorded in the confidential documentation under the reference number 22TH0506.
- (9) Compliance with the essential health and safety requirements has been assured by compliance with:  
**EN IEC 60079-0:2018      EN 60079-11:2012      EN 60079-26:2015**
- (10) If the sign "X" is placed after the certificate number, it indicates that the equipment is subject to special conditions for safe use specified in the annex to this certificate.
- (11) This UK - Type Examination Certificate relates only to the design and construction of the specified equipment in accordance with UKSI 2016:1107 (as amended). Further requirements apply to the manufacture of this equipment and its placing on the market. Those requirements are not covered by this certificate.
- (12) The marking of the equipment shall include the following:

II 1/2G Ex ia IIC T6...T3 Ga/Gb (for type 403025)  
 II 1/2D Ex ia IIIC T105°C Da/Db  
 II 1G Ex ia IIC T4 Ga (for DELTA type 403022)  
 II 1D Ex ia IIIC T200/125°C Da



Certification department of explosion protection

Warrington, 11-06-2024

*N. Wilkinson*  
Natalie Wilkinson

Certificates without signature and seal are void. This certificate is allowed to be distributed only if not modified. Extracts or modifications must be authorized by Bureau Veritas Consumer Products Services United Kingdom Limited. EPS 22 UKEX 1 369 X, Revision 1.

Bureau Veritas Consumer Products Services United Kingdom Limited  
<https://www.bureauveritas.co.uk/consumer-products-services>  
+44 (0) 1925 854 360

Registered Office: 4b Olympic Way  
Birchwood, Warrington, WA2 0YL

Registered in England & Wales  
Company Number: 00852439

ZERT-0003-GBR-ZE-EX-V03 / TEMP-0005-GBR-ZE-EX-V01

1/4

# 11 Certificates



## Annex

(13)

(14) UK - Type Examination Certificate EPS 22 UKEX 1 369 X

Revision 1

(15) Description of equipment:

The process pressure transmitter JUMO dTRANS p20 type 403025 or JUMO dTRANS p20 DELTA type 403022 serves for converting a physical measured quantity (pressure) into a standard electrical signal (4...20 mA). The device is intended for use within potentially explosive atmospheres. The stainless-steel enclosure of the pressure transmitter has the type of protection IP 66 according to IEC 60529. The pressure transmitter can be housed in three different types of enclosure.

The process pressure transmitter JUMO dTRANS p20 type 403025 or JUMO dTRANS p20 DELTA type 403022 is attached to tanks or pipes by means of a process connection. The pressure measuring cell serves for zone separation and is made of stainless steel, Hastelloy®, Monel, tantalum or titanium. This zone separation takes place by means of the diaphragm and subsequent flashback safe gap or the flashback safe gaps can also be integrated directly in the process connection upstream of the pressure measuring cell/pressure sensor.

### Electrical data:

Input and supply circuits

with type of protection intrinsic safety Ex ia IIC  
Only for connection to certified intrinsically safe circuits.  
Maximum values:  
 $U_i \leq 28 \text{ V}$   
 $I_i \leq 115 \text{ mA}$   
 $P_i \leq 750 \text{ mW}$   
 $C_i = 6 \text{ nF}$  (effective internal capacitance)  
 $L_i = 105 \text{ } \mu\text{H}$  (effective internal inductance)

Or

Input and supply circuits

with type of protection intrinsic safety Ex ia IIC  
Only for connection to certified intrinsically safe circuits.  
Maximum values:  
 $U_i \leq 28 \text{ V}$   
 $I_i \leq 115 \text{ mA}$   
 $P_i \leq 750 \text{ mW}$   
 $C_i = 6 \text{ nF}$  (effective internal capacitance)  
 $L_i = 105 \text{ } \mu\text{H}$  (effective internal inductance)

### Rated ambient temperature range:

#### For JUMO dTRANS p20 Typ 403025:

Ambient temperature <sup>1)</sup>:

T6: -40 °C ...+50 °C  
T5: -40 °C ...+65 °C  
T4: -40 °C ...+85 °C  
T3: -40 °C ...+85 °C <sup>3)</sup>  
T105 °C: -40 °C ...+60 °C <sup>3)</sup>

Extended ambient temperature with additional type 681 <sup>1)</sup> <sup>2)</sup>:

T6: -50 °C ...+50 °C  
T5: -50 °C ...+65 °C  
T4: -50 °C ...+85 °C  
T3: -50 °C ...+85 °C <sup>3)</sup>  
T105 °C: -50 °C ...+60 °C <sup>3)</sup>

Certificates without signature and seal are void. This certificate is allowed to be distributed only if not modified. Extracts or modifications must be authorized by Bureau Veritas Consumer Products Services United Kingdom Limited, EPS 22 UKEX 1 369 X, Revision 1.

Bureau Veritas Consumer Products Services United Kingdom Limited  
<https://www.bureauveritas.co.uk/consumer-products-testing>  
+44 (0) 1925 854 360

Registered Office: 4b Olympic Way  
Birchwood, Warrington, WA2 0YL

Registered in England & Wales  
Company Number: 00852439

ZERT-0003-GBR-ZE-EX-V03 / TEMP-0005-GBR-ZE-EX-V01

2/4



UK - Type Examination Certificate EPS 22 UKEX 1 369 X

Revision 1

For JUMO dTRANS p20 DELTA Typ 403022:

Ambient temperature:

T4: -50 °C ... +60 °C<sup>1)</sup>2)

T105 °C: -50 °C ... +60 °C<sup>3)</sup>

<sup>1)</sup> Restricted functions if lower than -20 °C: Stationary use, increased risk of cable break, display without function. Lower than -30 °C: the equipment is not possible to handle.

<sup>2)</sup> Between -40 °C to -50 °C the equipment must be permanently in operation and the cover with view window must be protected against to mechanical hit or impact. Please contact JUMO.

<sup>3)</sup> Only for high temperature version (measurement substance temperature 2).

(16) Reference number: 22TH0506

(17) Special conditions for safe use:

1. The intrinsically safe circuit must be limited to overvoltage category I as defined in IEC 60664-1 and the circuits must be supplied exclusively from a certified intrinsically safe power source with the protection level "ia".

2. Assignment between the maximum permissible ambient temperature in the electronics enclosure, measuring temperature and temperature class for the JUMO dTRANS p20 type 403025 process pressure transmitter is shown in the following table:

| Temperature class                                                              | T6                | T5                | T4                | T3                |
|--------------------------------------------------------------------------------|-------------------|-------------------|-------------------|-------------------|
| Maximum permissible temperature in top part of enclosure with electronics (°C) | -50 °C ... +50 °C | -50 °C ... +65 °C | -50 °C ... +85 °C | -50 °C ... +85 °C |
| Maximum permissible measuring temperature                                      | +60 °C            | +70 °C            | +115 °C           | +175 °C           |

3. Assignment between the maximum permissible ambient temperature in the electronics enclosure, measuring temperature and temperature class for the JUMO dTRANS p20 DELTA type 403022 process pressure transmitter is shown in the following table:

| Temperature class                                                              | T4                |
|--------------------------------------------------------------------------------|-------------------|
| Maximum permissible temperature in top part of enclosure with electronics (°C) | -50 °C ... +60 °C |
| Maximum permissible measuring temperature                                      | +100 °C           |

Certificates without signature and seal are void. This certificate is allowed to be distributed only if not modified. Extracts or modifications must be authorized by Bureau Veritas Consumer Products Services United Kingdom Limited. EPS 22 UKEX 1 369 X, Revision 1.

Bureau Veritas Consumer Products Services United Kingdom Limited  
<https://www.bureauveritas.co.uk/consumer-products-testing>  
+44 (0) 1925 854 360

Registered Office: 4b Olympic Way  
Birchwood, Warrington, WA2 0YL

Registered in England & Wales  
Company Number: 00852439

ZERT-0003-GBR-ZE-EX-V03 / TEMP-0005-GBR-ZE-EX-V01

3/4

# 11 Certificates



UKAS  
PRODUCT  
CERTIFICATION  
5111



BUREAU  
VERITAS



UK - Type Examination Certificate EPS 22 UKEX 1 369 X

Revision 1

4. Assignment between the maximum permissible ambient temperature in the electronics enclosure, measuring temperature and maximum surface temperature for the **JUMO dTRANS p20 type 403025** process pressure transmitter is shown in the fo lollowing table:

|                                                                                |                   |
|--------------------------------------------------------------------------------|-------------------|
| Surface temperature (°C)                                                       | T105°C            |
| Maximum permissible temperature in top part of enclosure with electronics (°C) | -50 °C ... +60 °C |
| Maximum permissible measuring temperature                                      | +100 °C           |

5. Assignment between the maximum permissible ambient temperature in the electronics enclosure, measuring temperature and maximum surface temperature for the **JUMO dTRANS p20 DELTA type 403022** process pressure transmitter is shown in the following table:

|                                                                                |                        |
|--------------------------------------------------------------------------------|------------------------|
| Surface temperature (°C)                                                       | T <sub>200</sub> 125°C |
| Maximum permissible temperature in top part of enclosure with electronics (°C) | -50 °C ... +60 °C      |
| Maximum permissible measuring temperature                                      | +100 °C                |

6. In the temperature range of -40 °C -50 °C the lid with inspection glass of the appliance has to be additionally protected against mechanical impact- respectively collision effect.

(18) Essential health and safety requirements:

Met by compliance with standards.



Certification department of explosion protection

*N. Wilkinson*  
Natalie Wilkinson

Warrington, 11-06-2024

Certificates without signature and seal are void. This certificate is allowed to be distributed only if not modified. Extracts or modifications must be authorized by Bureau Veritas Consumer Products Services United Kingdom Limited. EPS 22 UKEX 1 369 X, Revision 1.

Bureau Veritas Consumer Products Services United Kingdom Limited  
<https://www.bureauveritas.co.uk/consumer-products-testing>  
+44 (0) 1925 854 360

ZERT-0003-GBR-ZE-EX-V03 / TEMP-0005-GBR-ZE-EX-V01

Registered Office: 4b Olympic Way  
Birchwood, Warrington, WA2 0YL

Registered in England & Wales  
Company Number: 00852439

4/4

|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |  | 有毒有害物质或元素 Hazardous substances                                                      |        |        |              |            |              |  |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|-------------------------------------------------------------------------------------|--------|--------|--------------|------------|--------------|--|
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |  |  |        |        |              |            |              |  |
| 部件名称                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |  |                                                                                     |        |        |              |            |              |  |
| Product group: 403025                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |  |                                                                                     |        |        |              |            |              |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |  | 铅 (Pb)                                                                              | 汞 (Hg) | 镉 (Cd) | 六价铬 (Cr(VI)) | 多溴联苯 (PBB) | 多溴二苯醚 (PBDE) |  |
| 外壳<br>Housing<br>(Gehäuse)                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |  | ○                                                                                   | ○      | ○      | ○            | ○          | ○            |  |
| 过程连接<br>Process connection<br>(Prozessanschluss)                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                               |  | X                                                                                   | ○      | ○      | ○            | ○          | ○            |  |
| -螺母<br>Nut<br>(Mutter)                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |  | ○                                                                                   | ○      | ○      | ○            | ○          | ○            |  |
| 螺钉<br>Screw<br>(Schraube)                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |  | ○                                                                                   | ○      | ○      | ○            | ○          | ○            |  |
| <p>本表格依据 SJ/T 11364-2014 的规定编制。<br/>(This table is prepared in accordance with the provisions of SJ/T 11364-2014.)<br/>O : 表示该有害物质在该部件所有均质材料中的含量均在 GB/T 26572 规定的限量要求以下。<br/>(O: Indicates that said hazardous substance contained in all of the homogeneous materials for this part is below the limit requirement of GB/T 26572.)<br/>X : 表示该有害物质至少在该部件的某一均质材料中的含量超出 GB/T 26572 规定的限量要求。<br/>(X: Indicates that said hazardous substance contained in one of the homogeneous materials used for this part is above the limit requirement of GB/T 26572.)</p> |  |                                                                                     |        |        |              |            |              |  |







**JUMO GmbH & Co. KG**

Street address:  
Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Delivery address:  
Mackenrodtstraße 14  
36039 Fulda, Germany

Postal address:  
36035 Fulda, Germany

Phone: +49 661 6003-0  
Fax: +49 661 6003-607  
Email: [mail@jumo.net](mailto:mail@jumo.net)  
Internet: [www.jumo.net](http://www.jumo.net)

**JUMO UK LTD**

JUMO House  
Temple Bank, Riverway  
Harlow, Essex, CM20 2DY, UK

Phone: +44 1279 63 55 33  
Fax: +44 1279 62 50 29  
Email: [sales@jumo.co.uk](mailto:sales@jumo.co.uk)  
Internet: [www.jumo.co.uk](http://www.jumo.co.uk)

**JUMO Process Control, Inc.**

6724 Joy Road  
East Syracuse, NY 13057, USA

Phone: +1 315 437 5866  
Fax: +1 315 437 5860  
Email: [info.us@jumo.net](mailto:info.us@jumo.net)  
Internet: [www.jumousa.com](http://www.jumousa.com)

